

PROJECT DRAWINGS

for

Proposed Offices for Kenya Urban Roads Authority

IN LOWER EASTERN REGION

Machakos County

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated.
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

GROUND FLOOR

JOB NO

DRG.NO

A100

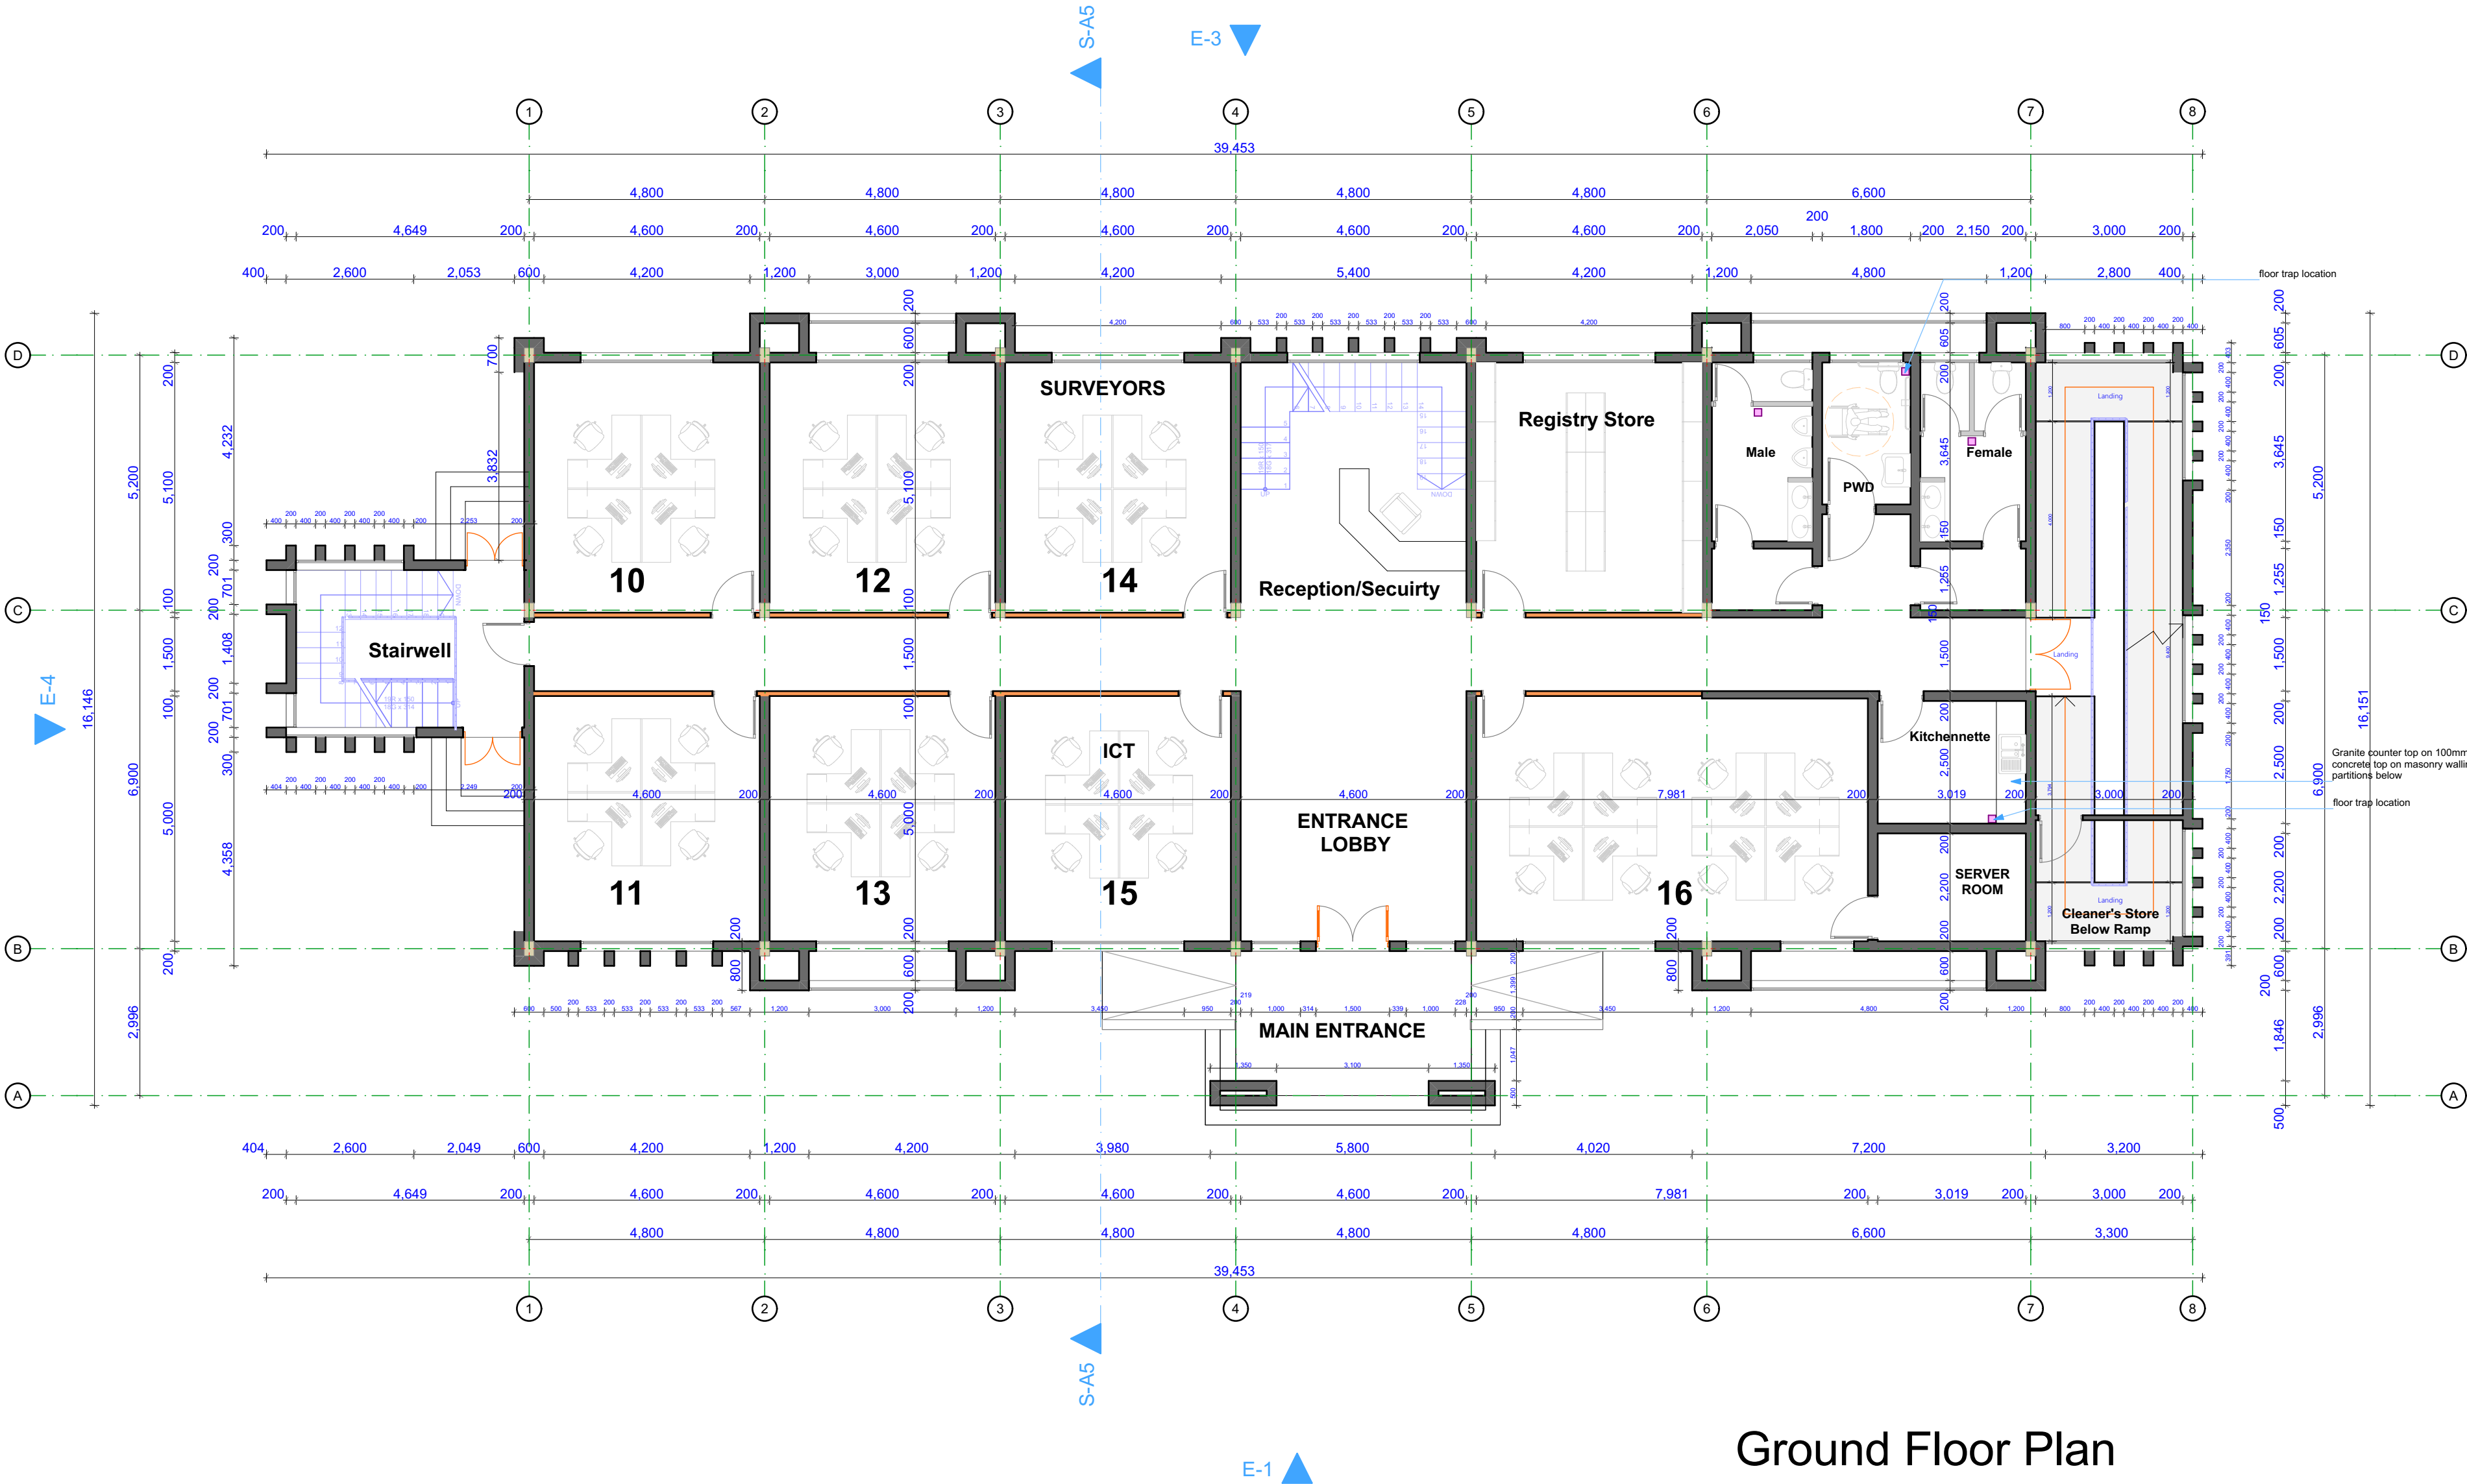

Ground Floor Plan
Scale 1:100

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act, and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work. Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated .
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

[illegible]

ARCHITECT

CLIENT _____

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN _____

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _____


DRAWING TITLE

FIRST FLOOR

JOB NO	DRG.NO
--------	--------

DRG.NO

A101

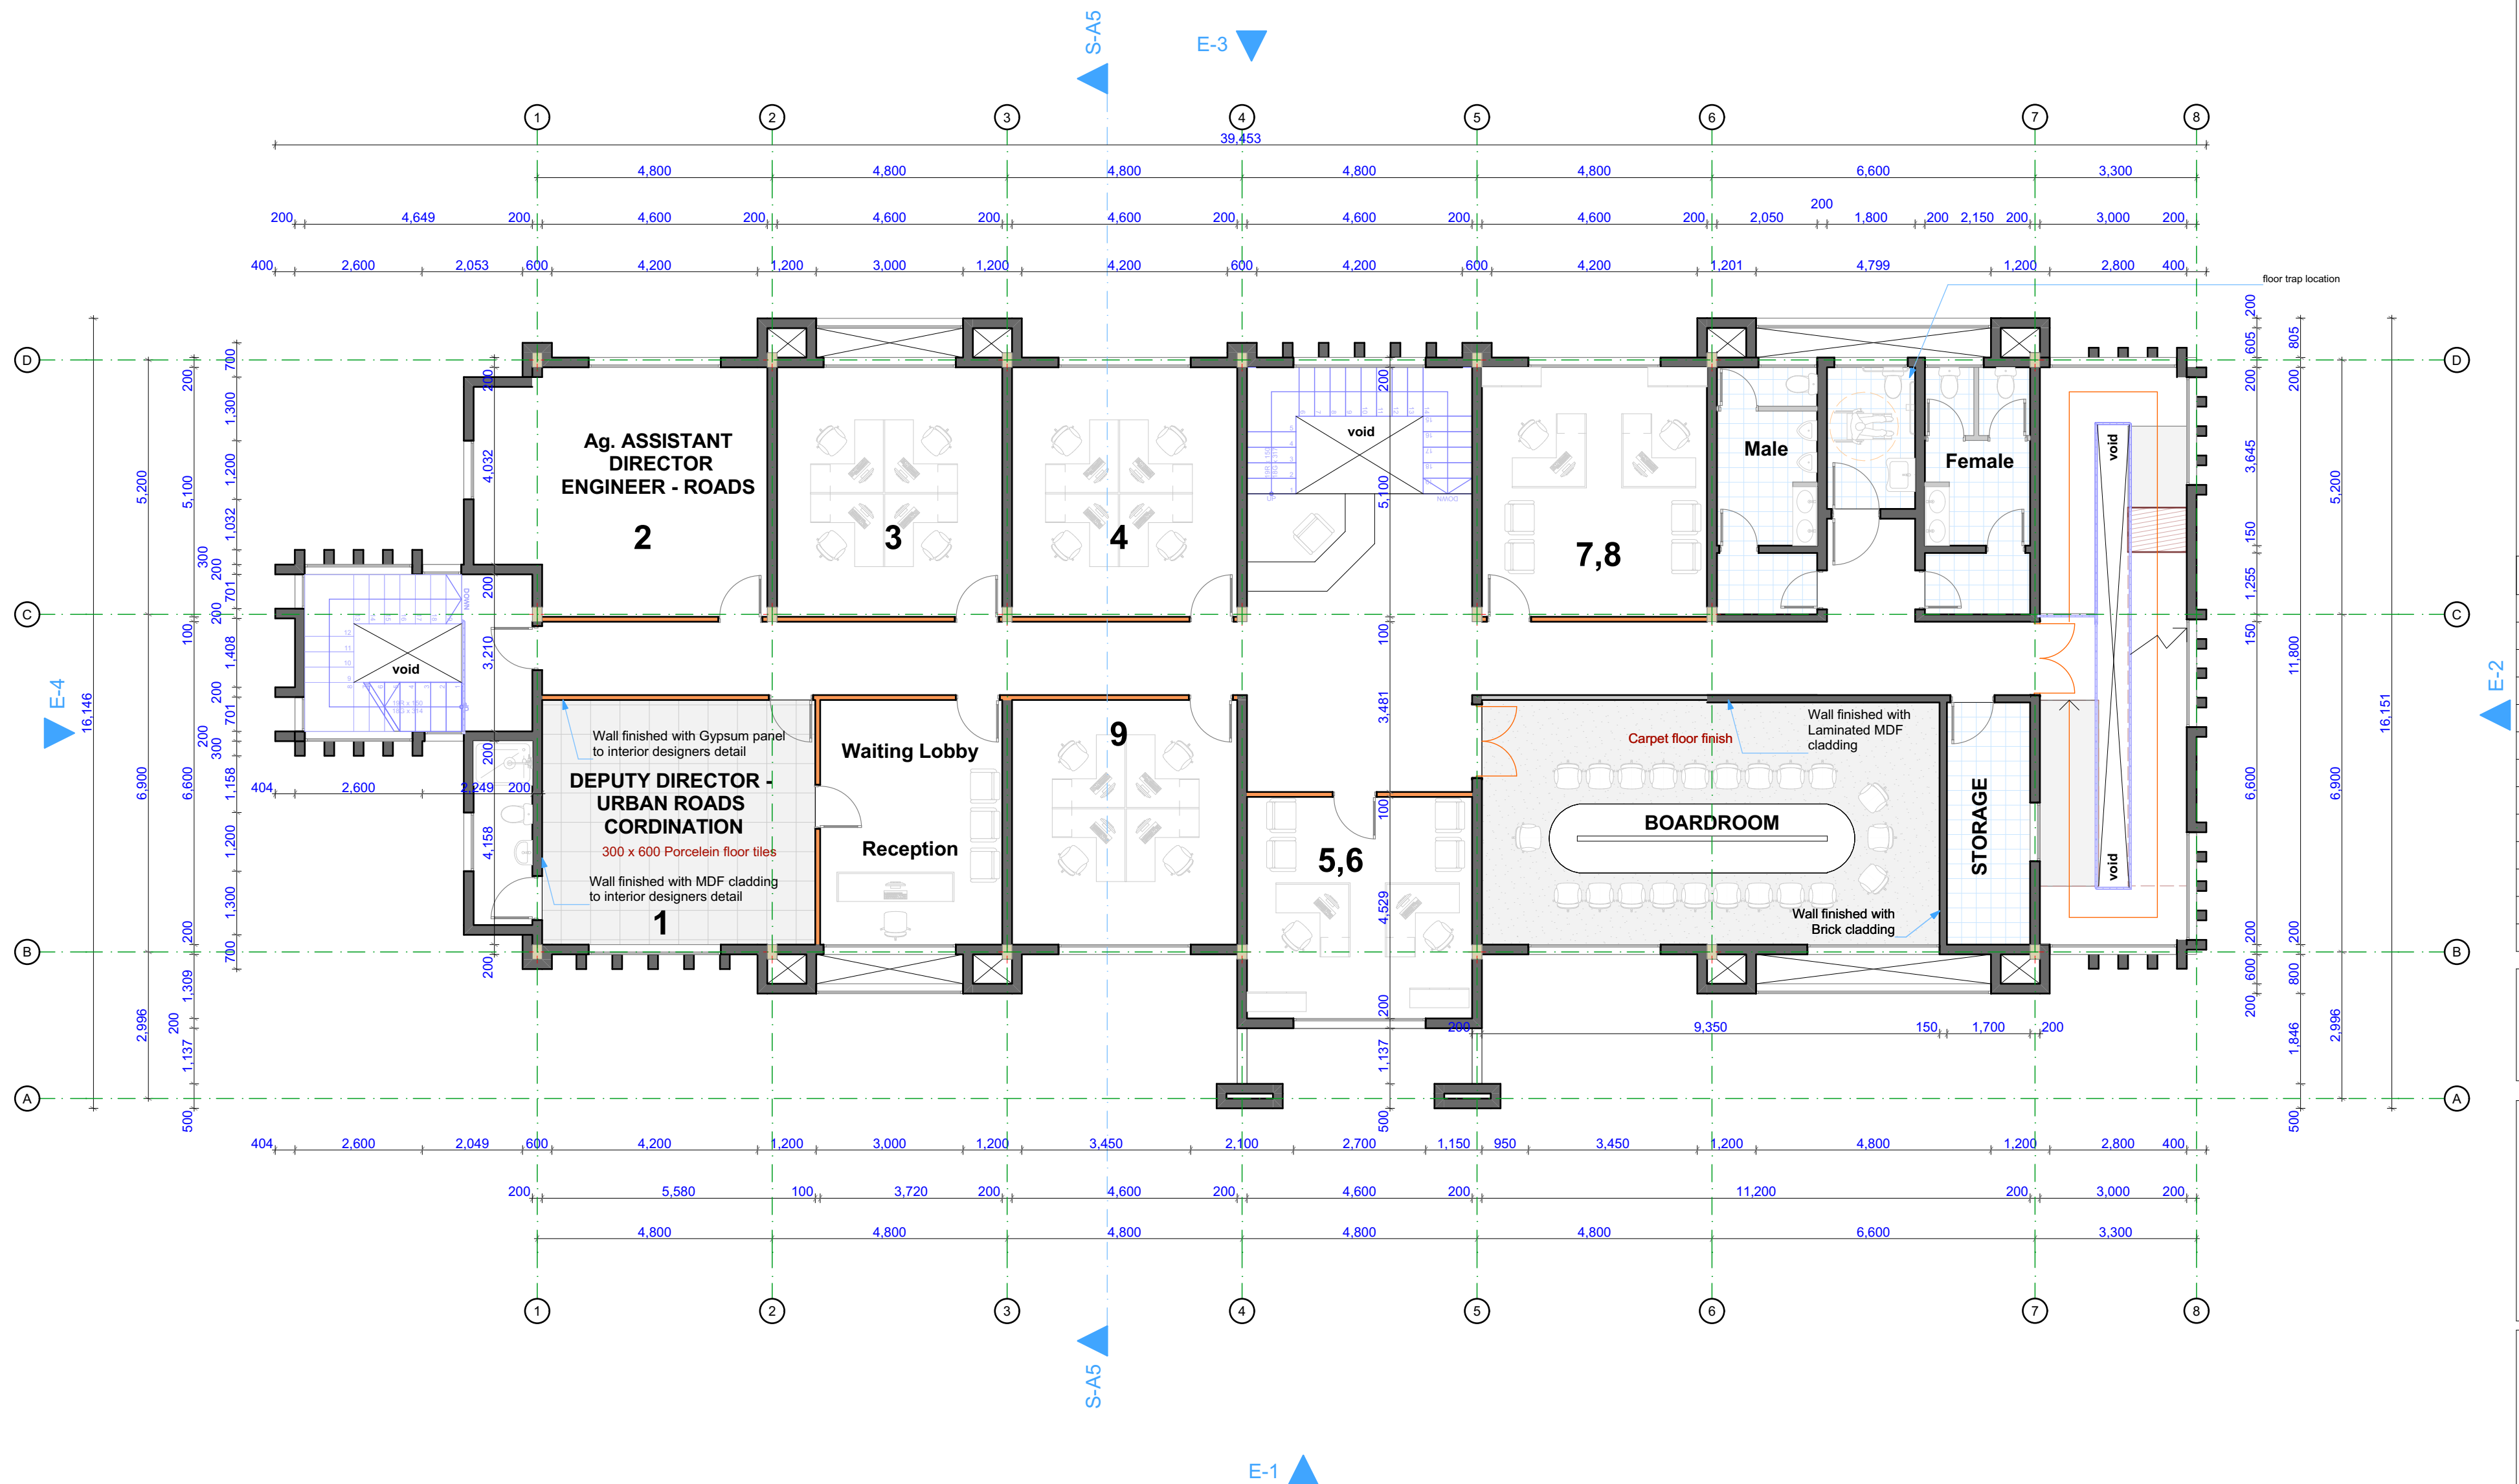

First Floor Plan

Scale 1:100

GENERAL NOTES

- ## REVISIONS

ARCHITECT

CLIENT

DIRECTOR (RACM)

SIGN _____

DATE _____

PROJECT


SITE: L.R. No. _____

DRAWING TITLE

JOB NO


DRG.NO

A102

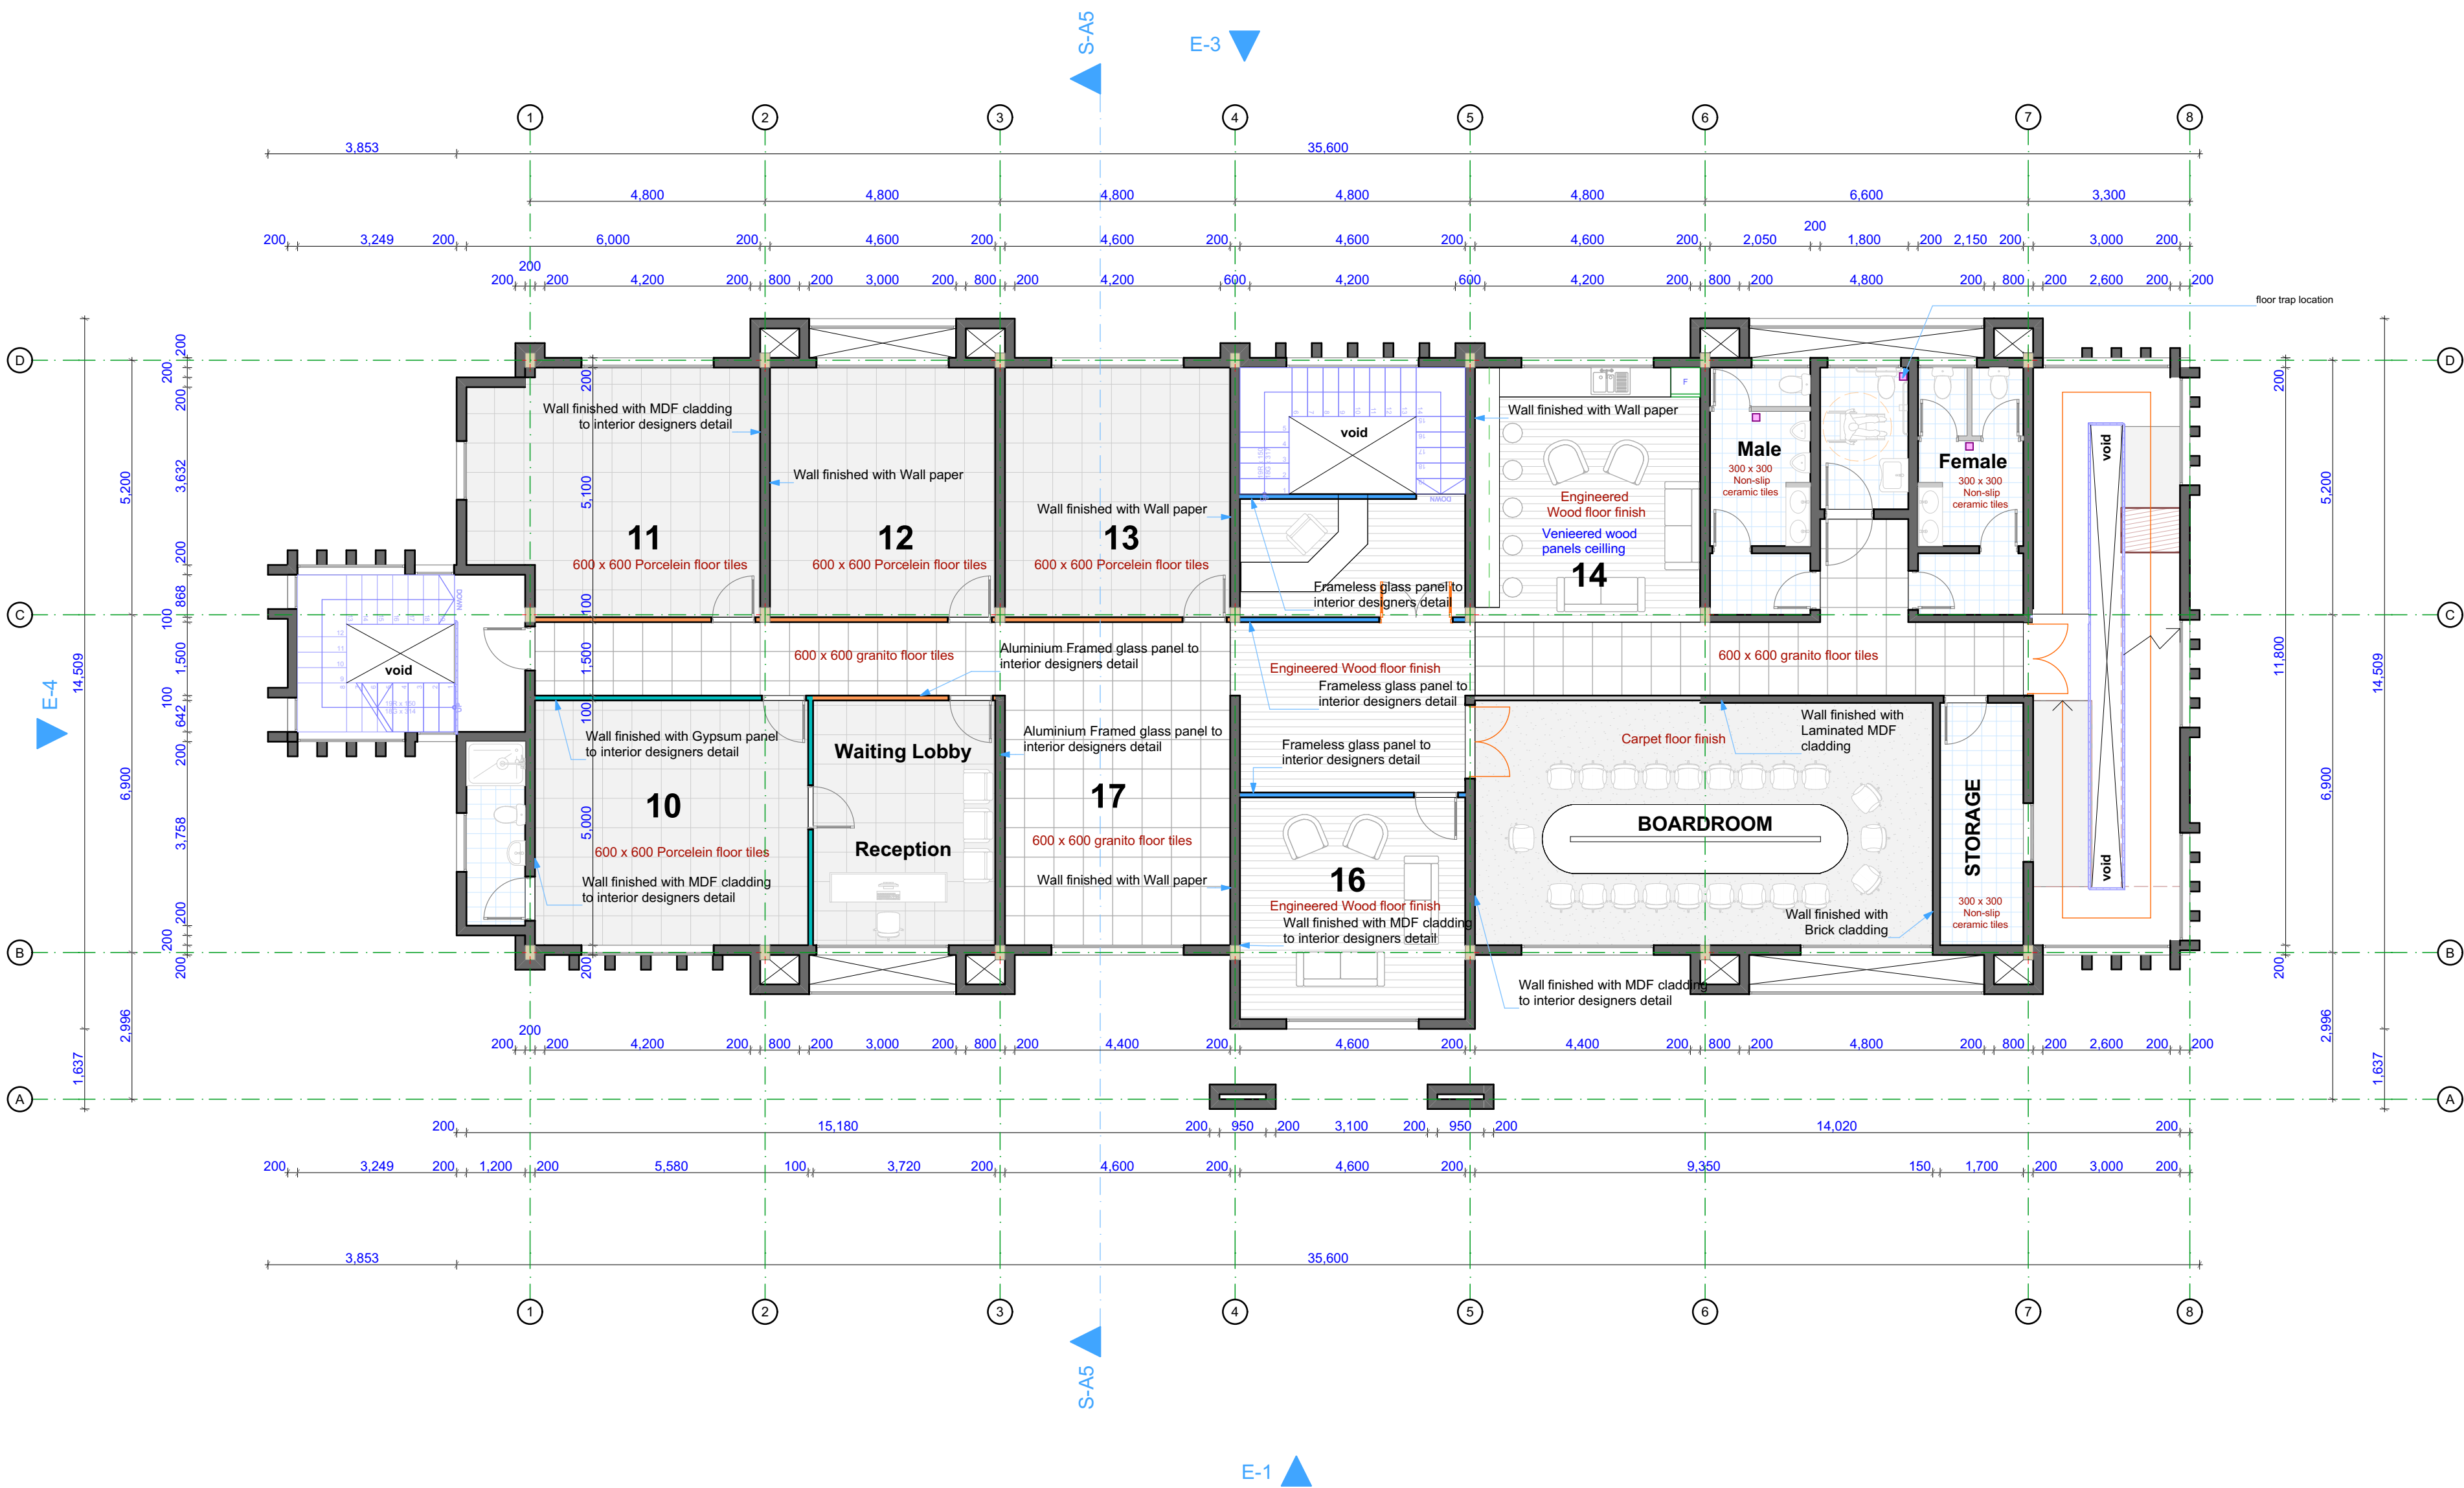

Second Floor Plan

Scale 1:100

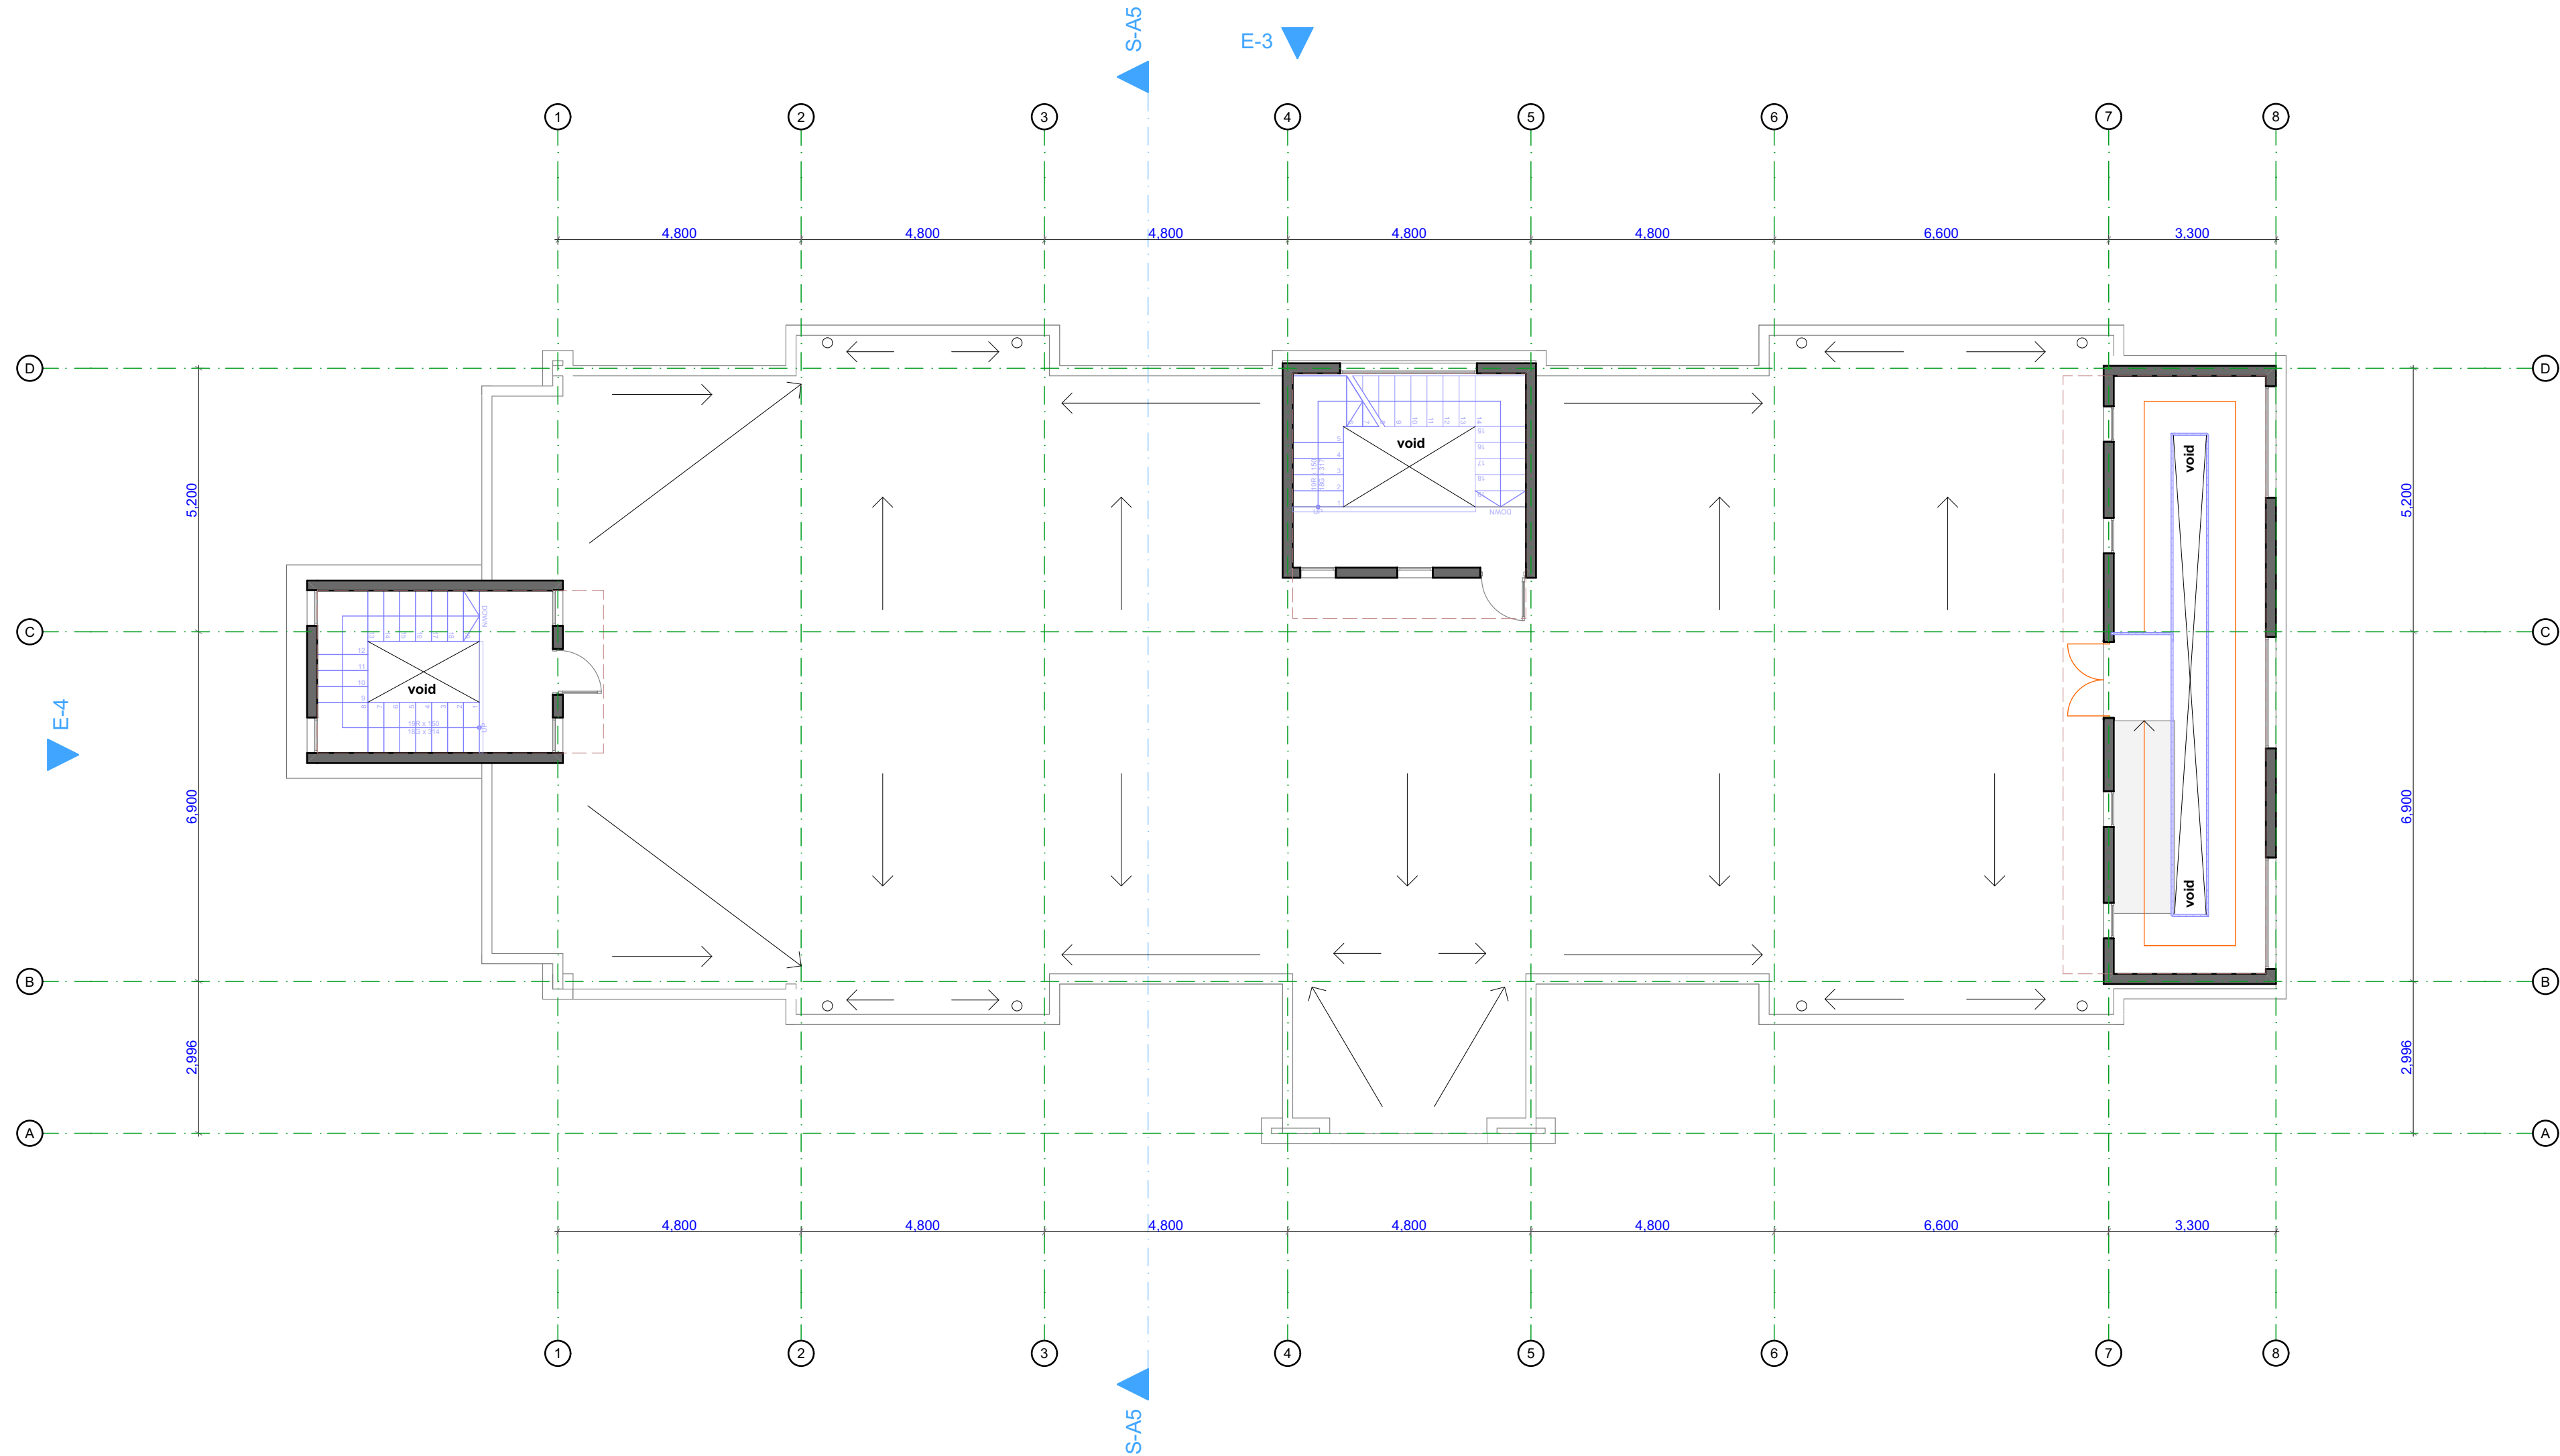

Roof Plan 01
Scale 1:100

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

ROOF FLOOR

JOB NO

DRG.NO

A103

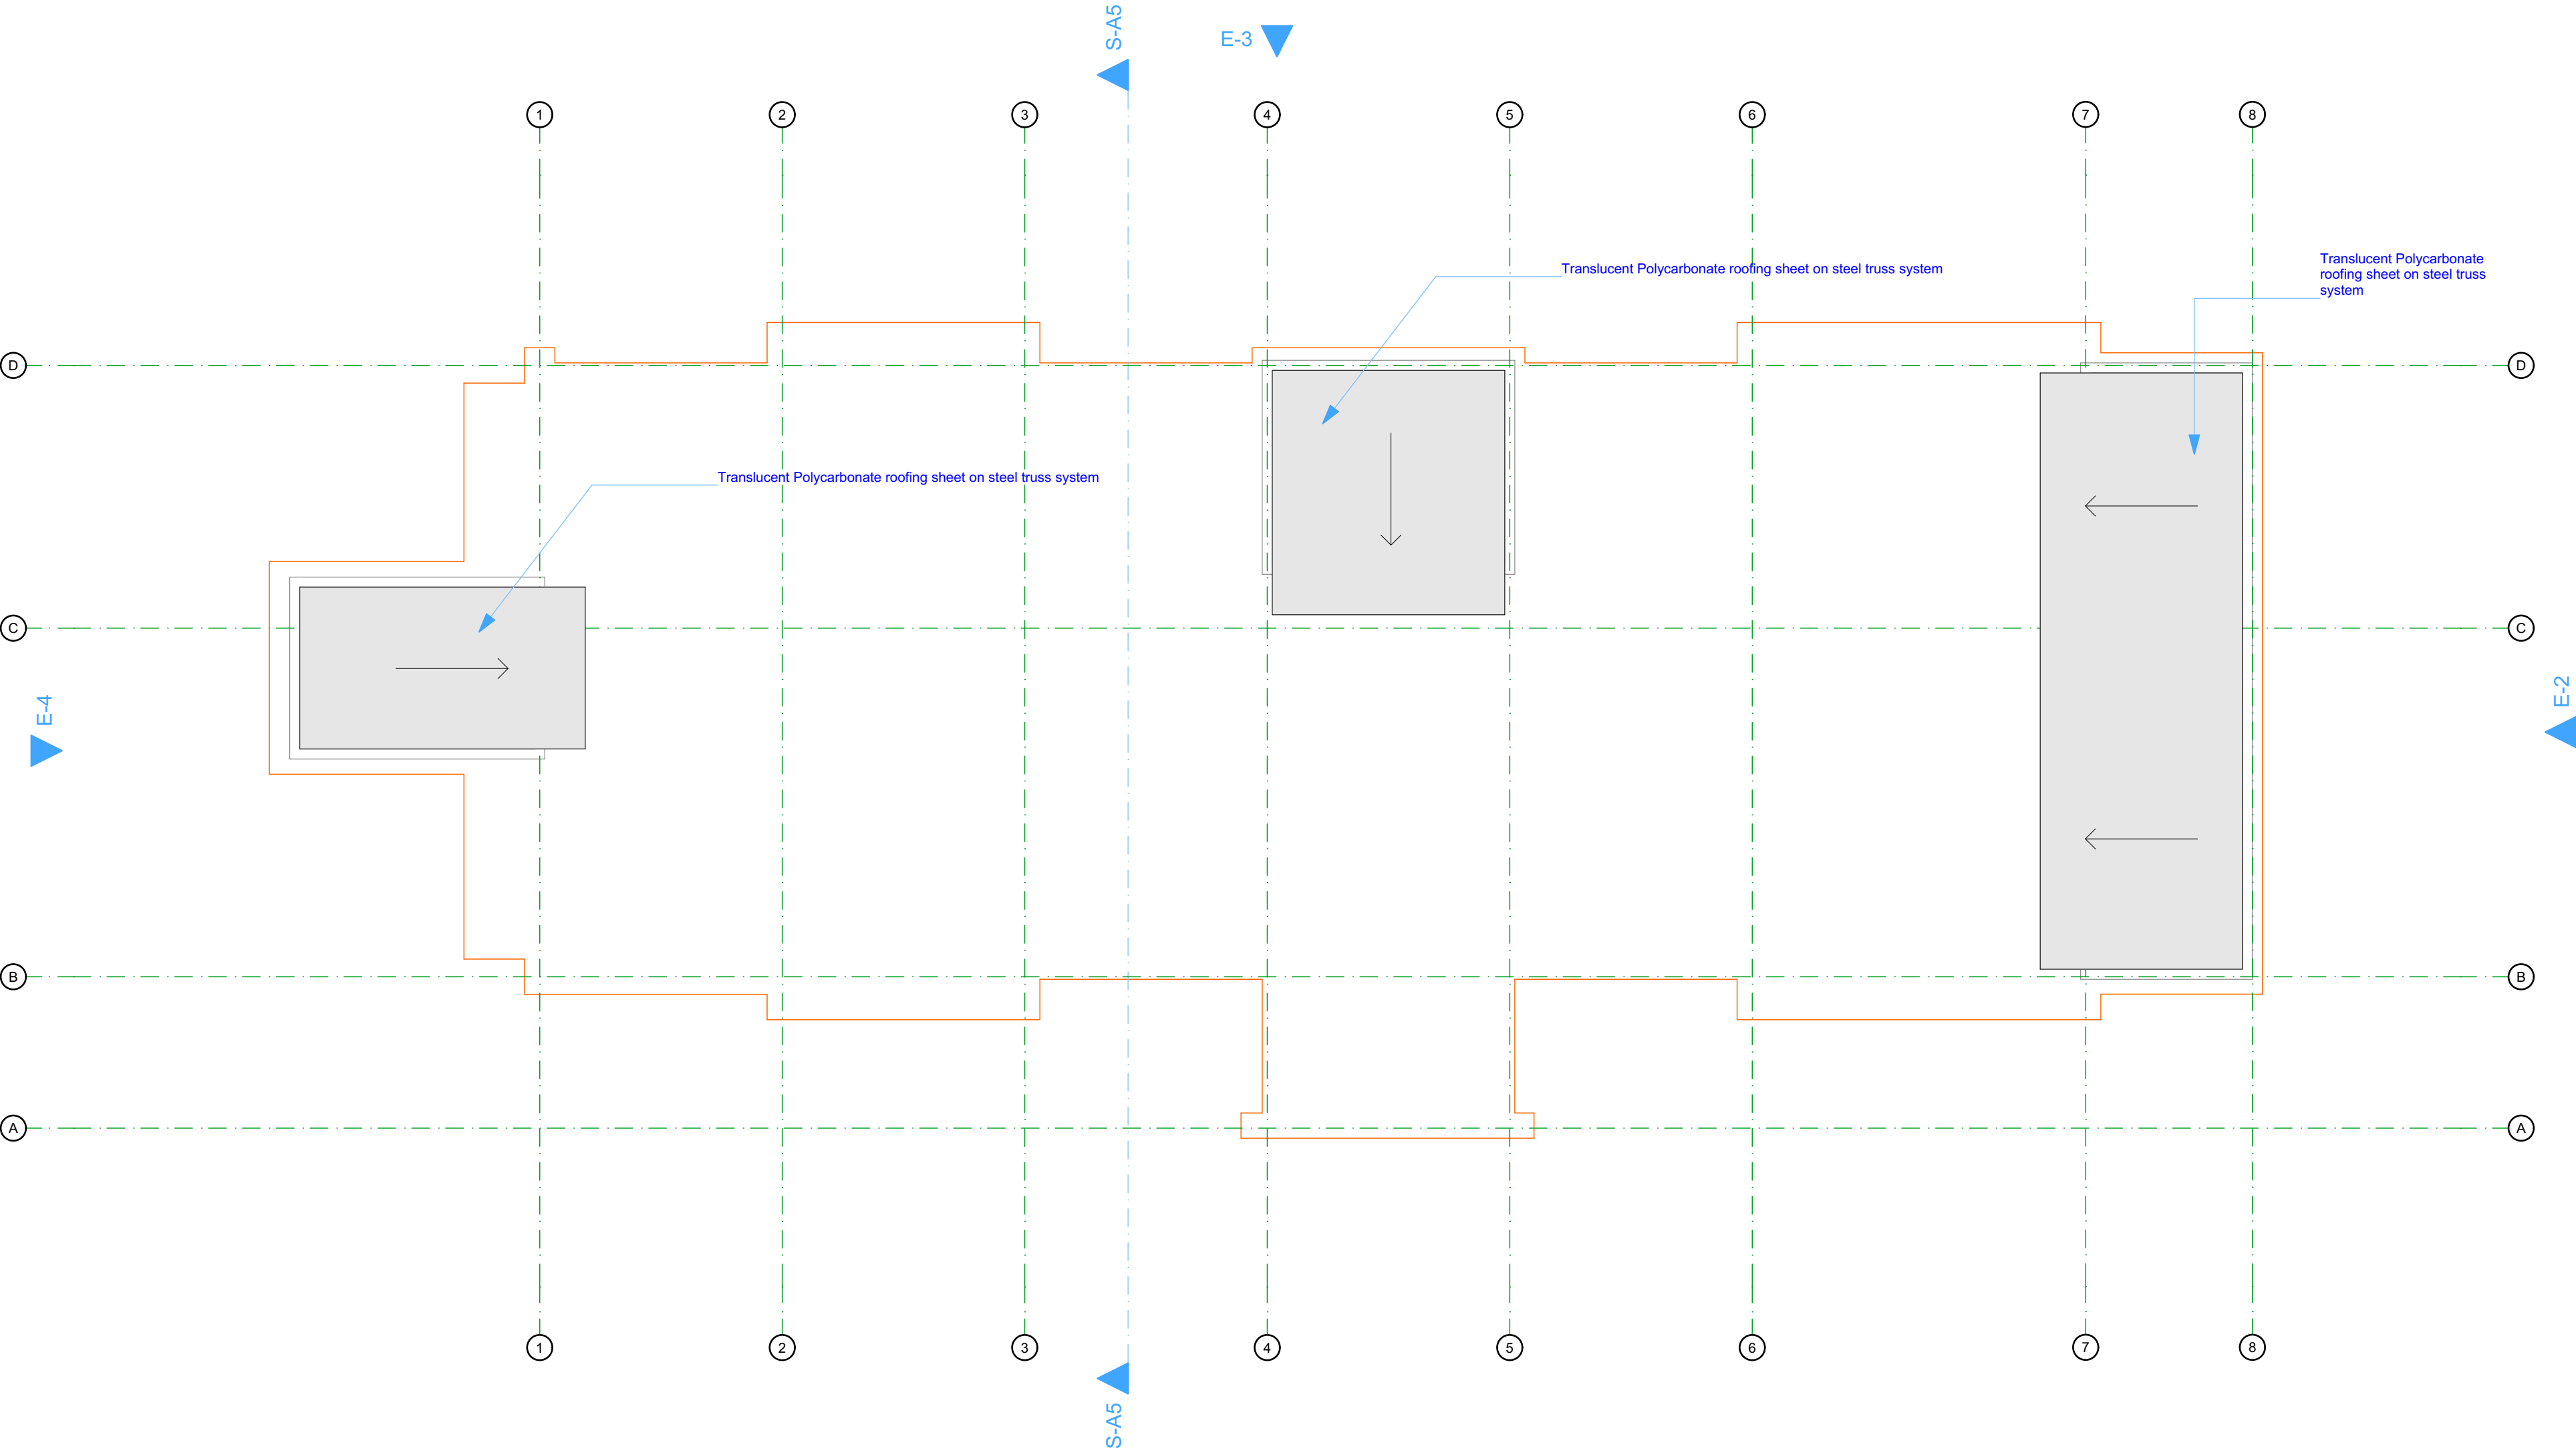

Roof Plan 02
Scale 1:100

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)
SIGN _____

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

ROOF FLOOR

JOB NO

DRG.NO

A104



E-1 Elevation (2) 1:100



E-3 Elevation (2) 1:100

NOTES

- GENERAL NOTES**
- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
 - 2 Read only figured dimensions .
 - 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
 - 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
 - 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
 - 6 Water Meter to be 300mm above G.L.
 - 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
 - 8 All R.C. works to structural engineer's details.
 - 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
 - 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
 - 11 All levels shown are finished levels unless otherwise stated.
 - 12 All surface beds to be cast on well compacted and well consolidated filling .
 - 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
 - 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

ELEVATIONS

JOB NO

DRG.NO

A105

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations .
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L..
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work. Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated .
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

[illegible]

ARCHITECT

CLIENT _____

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _____


DRAWING TITLE

ELEVATION, SECTION

JOB NO	DRG.NO
--------	--------


DRG.NO

A106

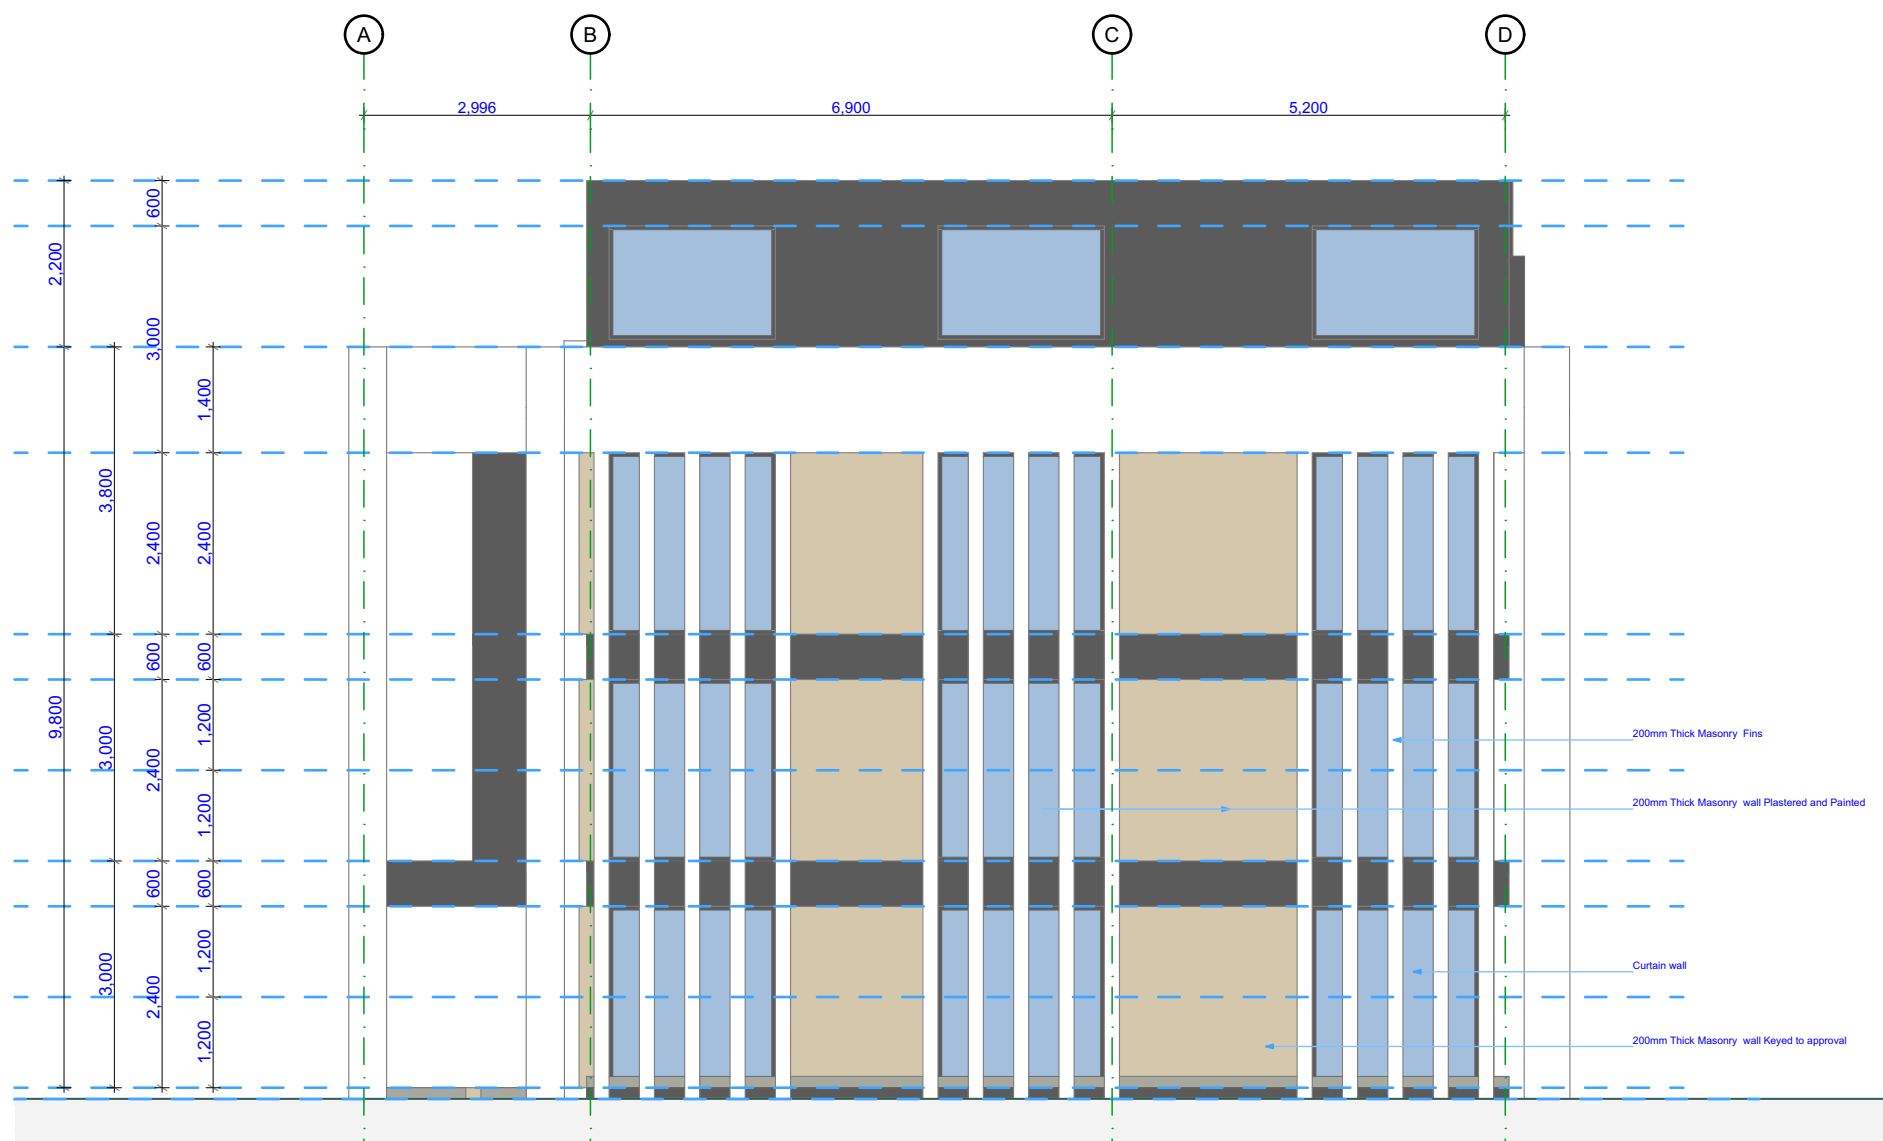

Elevation (2) 1:100


1:100

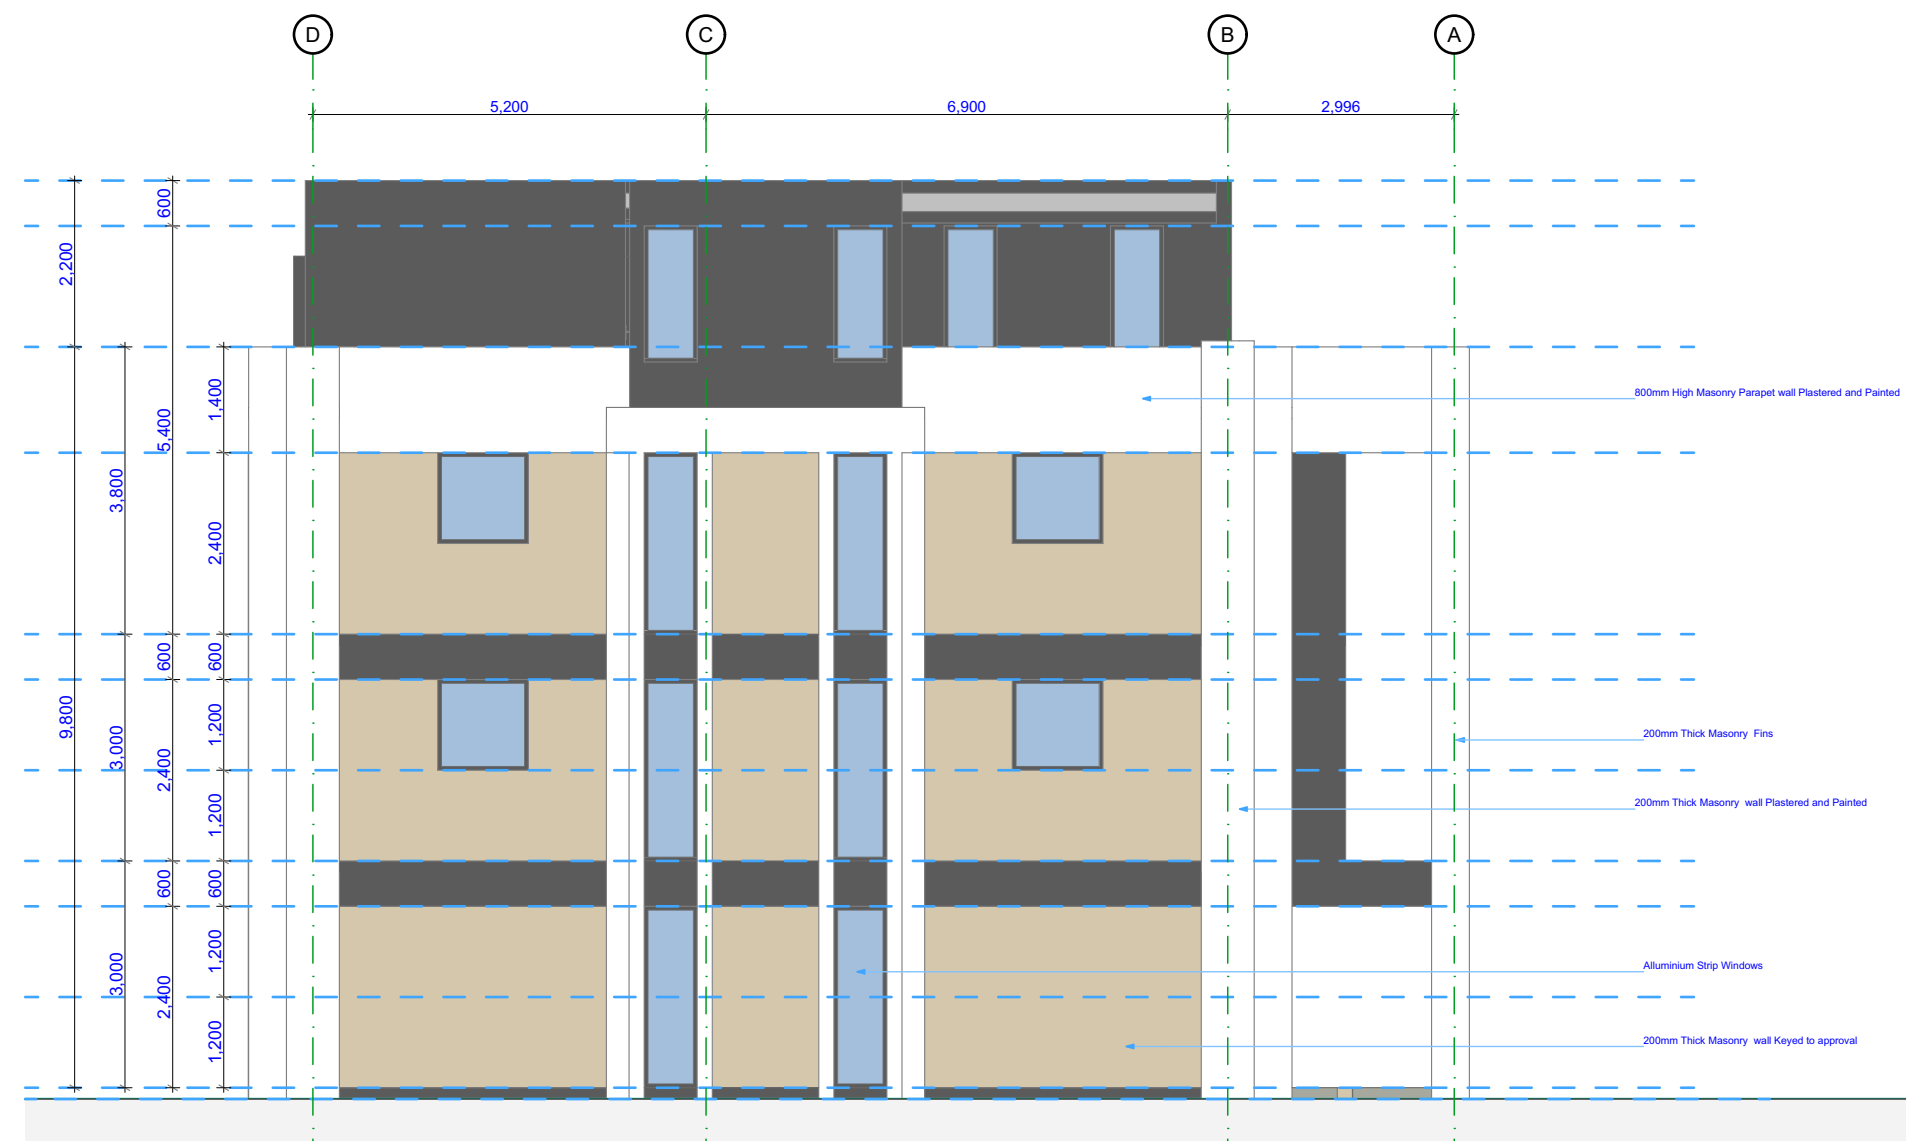

E-4 Elevation (2) 1:100


Elevation (2) 1:100

1:100

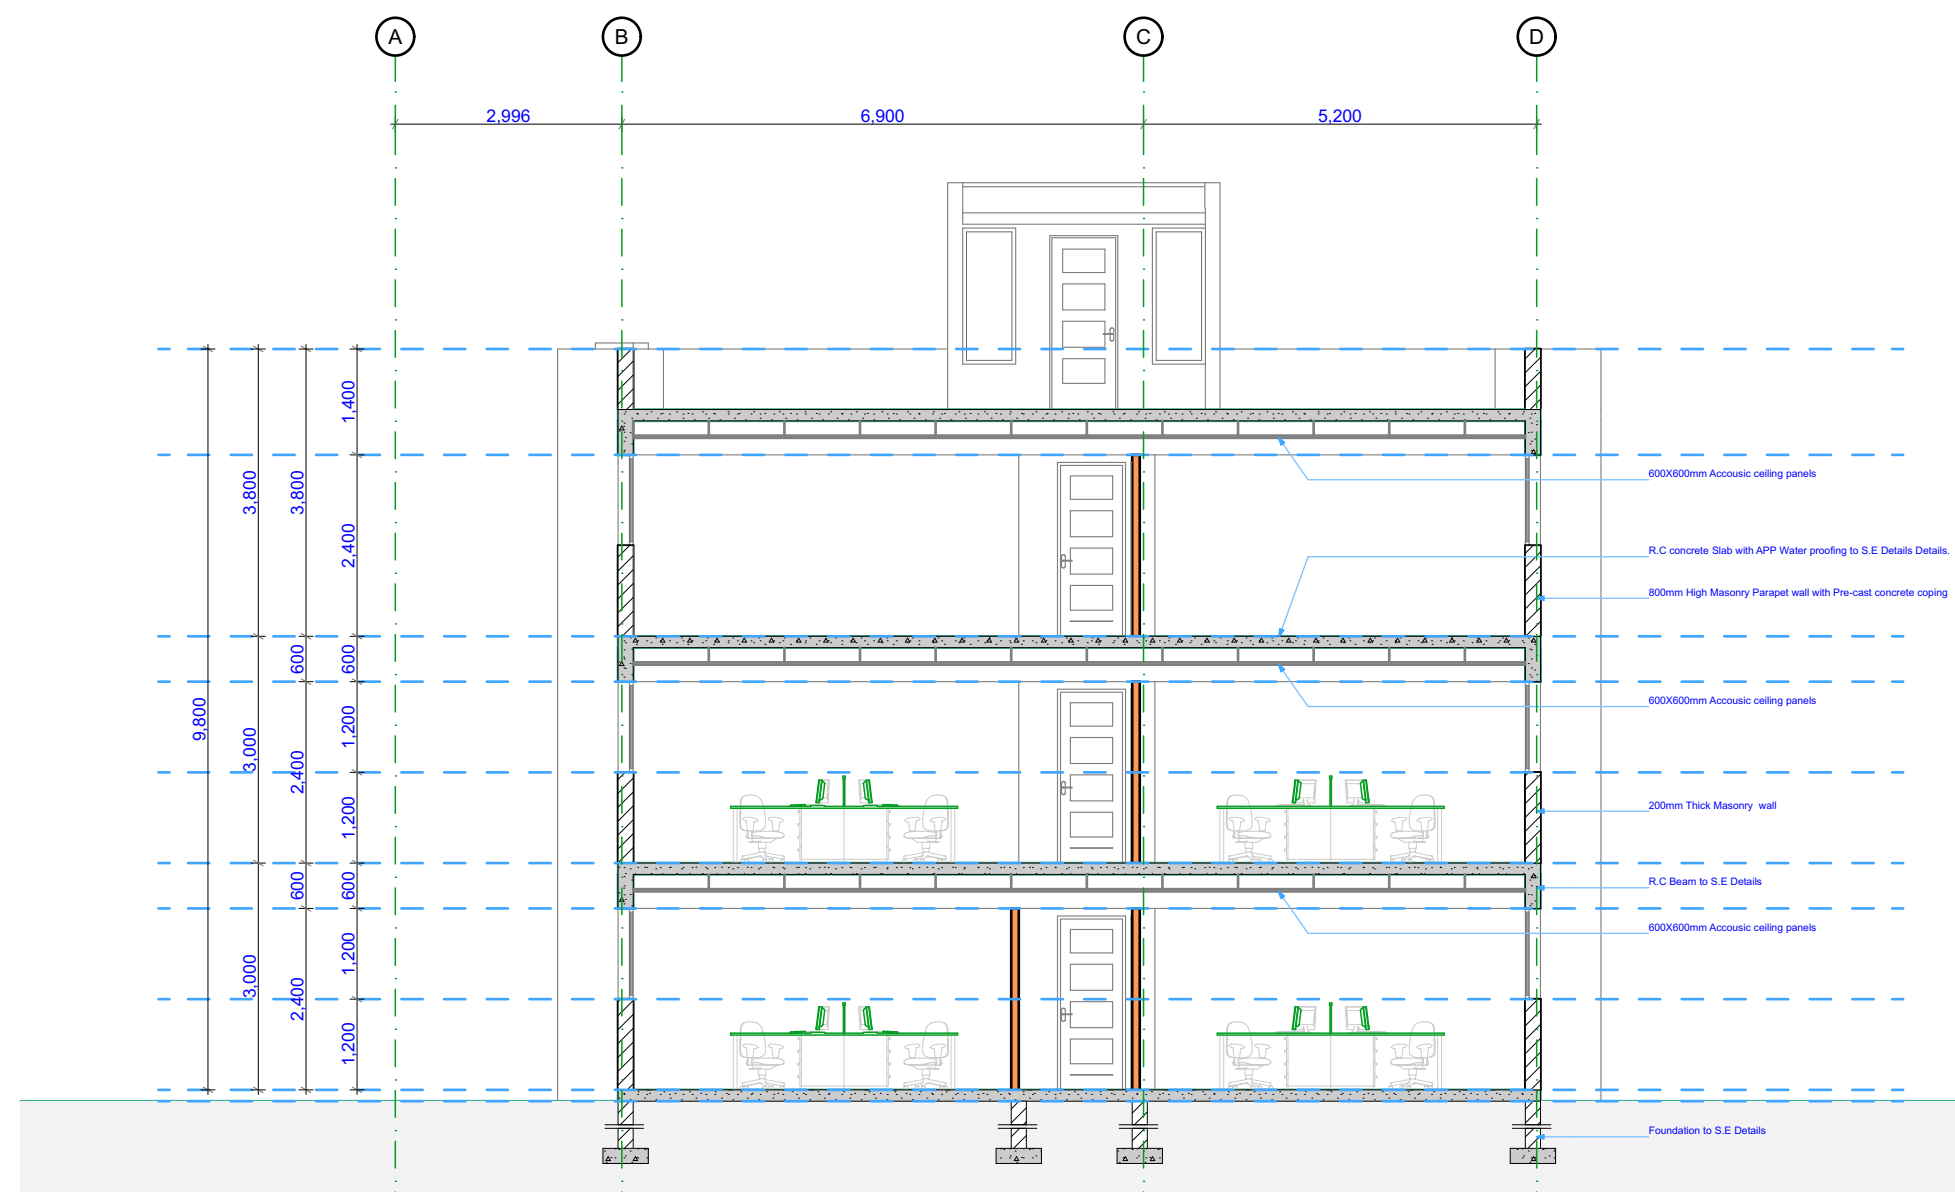

Building Section 1:100

1:100

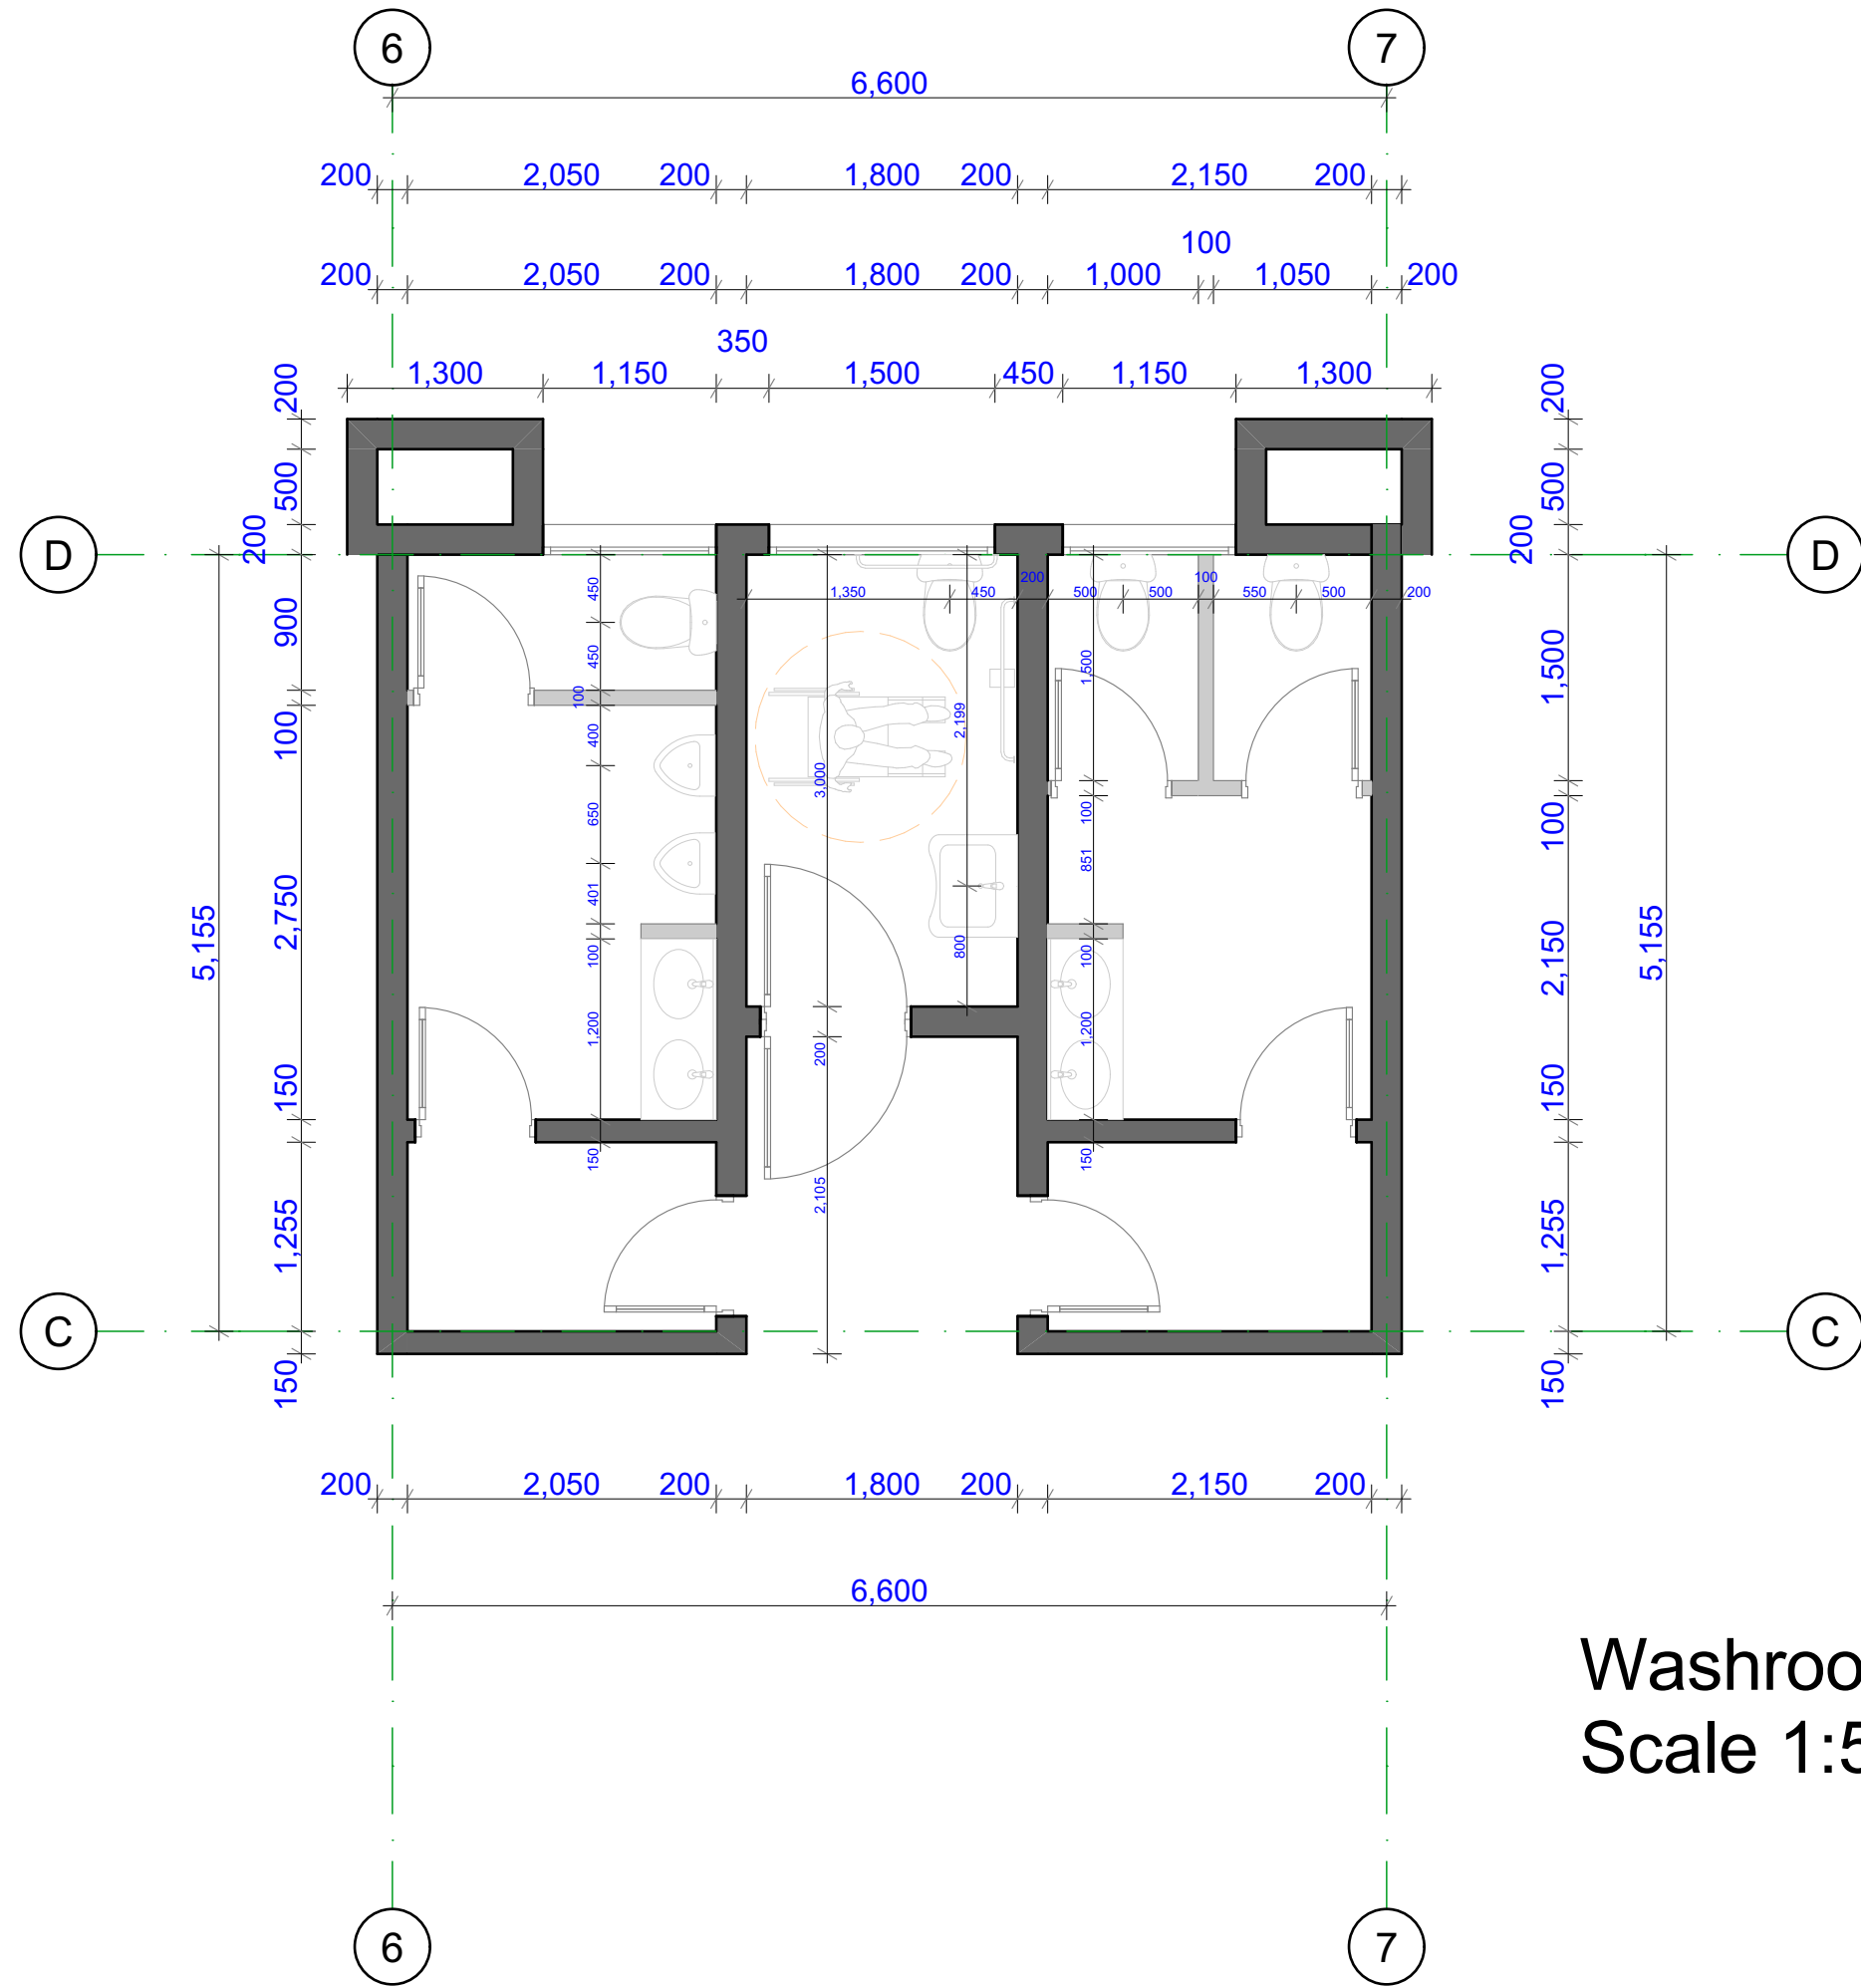

Washrooms Floor Plan
Scale 1:50

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

WASHROOM


JOB NO

DRG.NO

A107

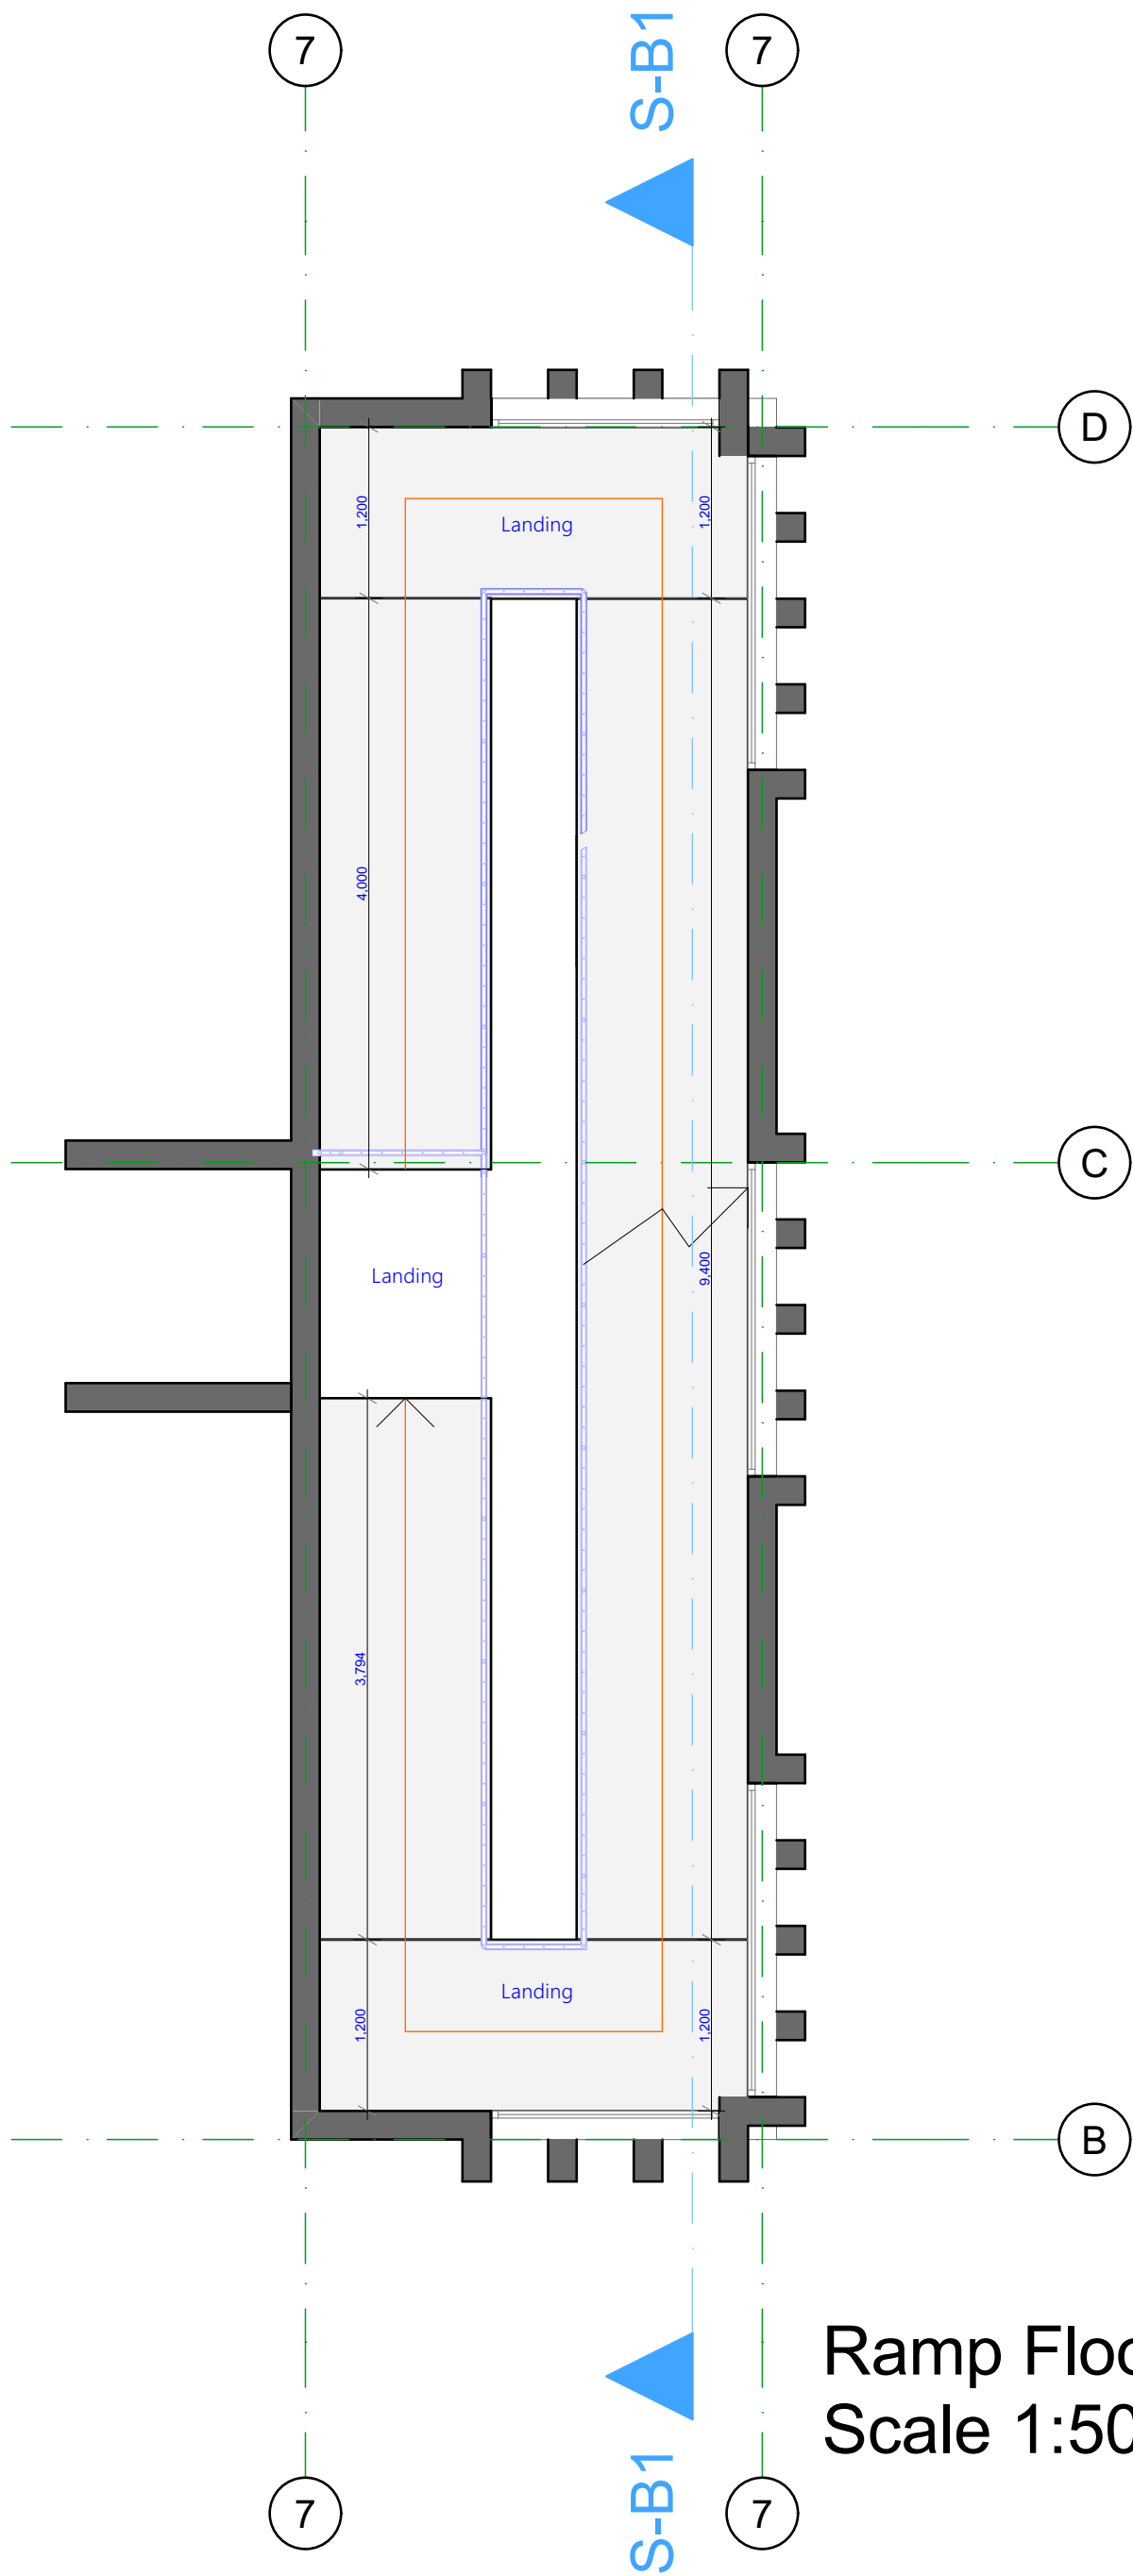

Ramp Floor Layout
Scale 1:50

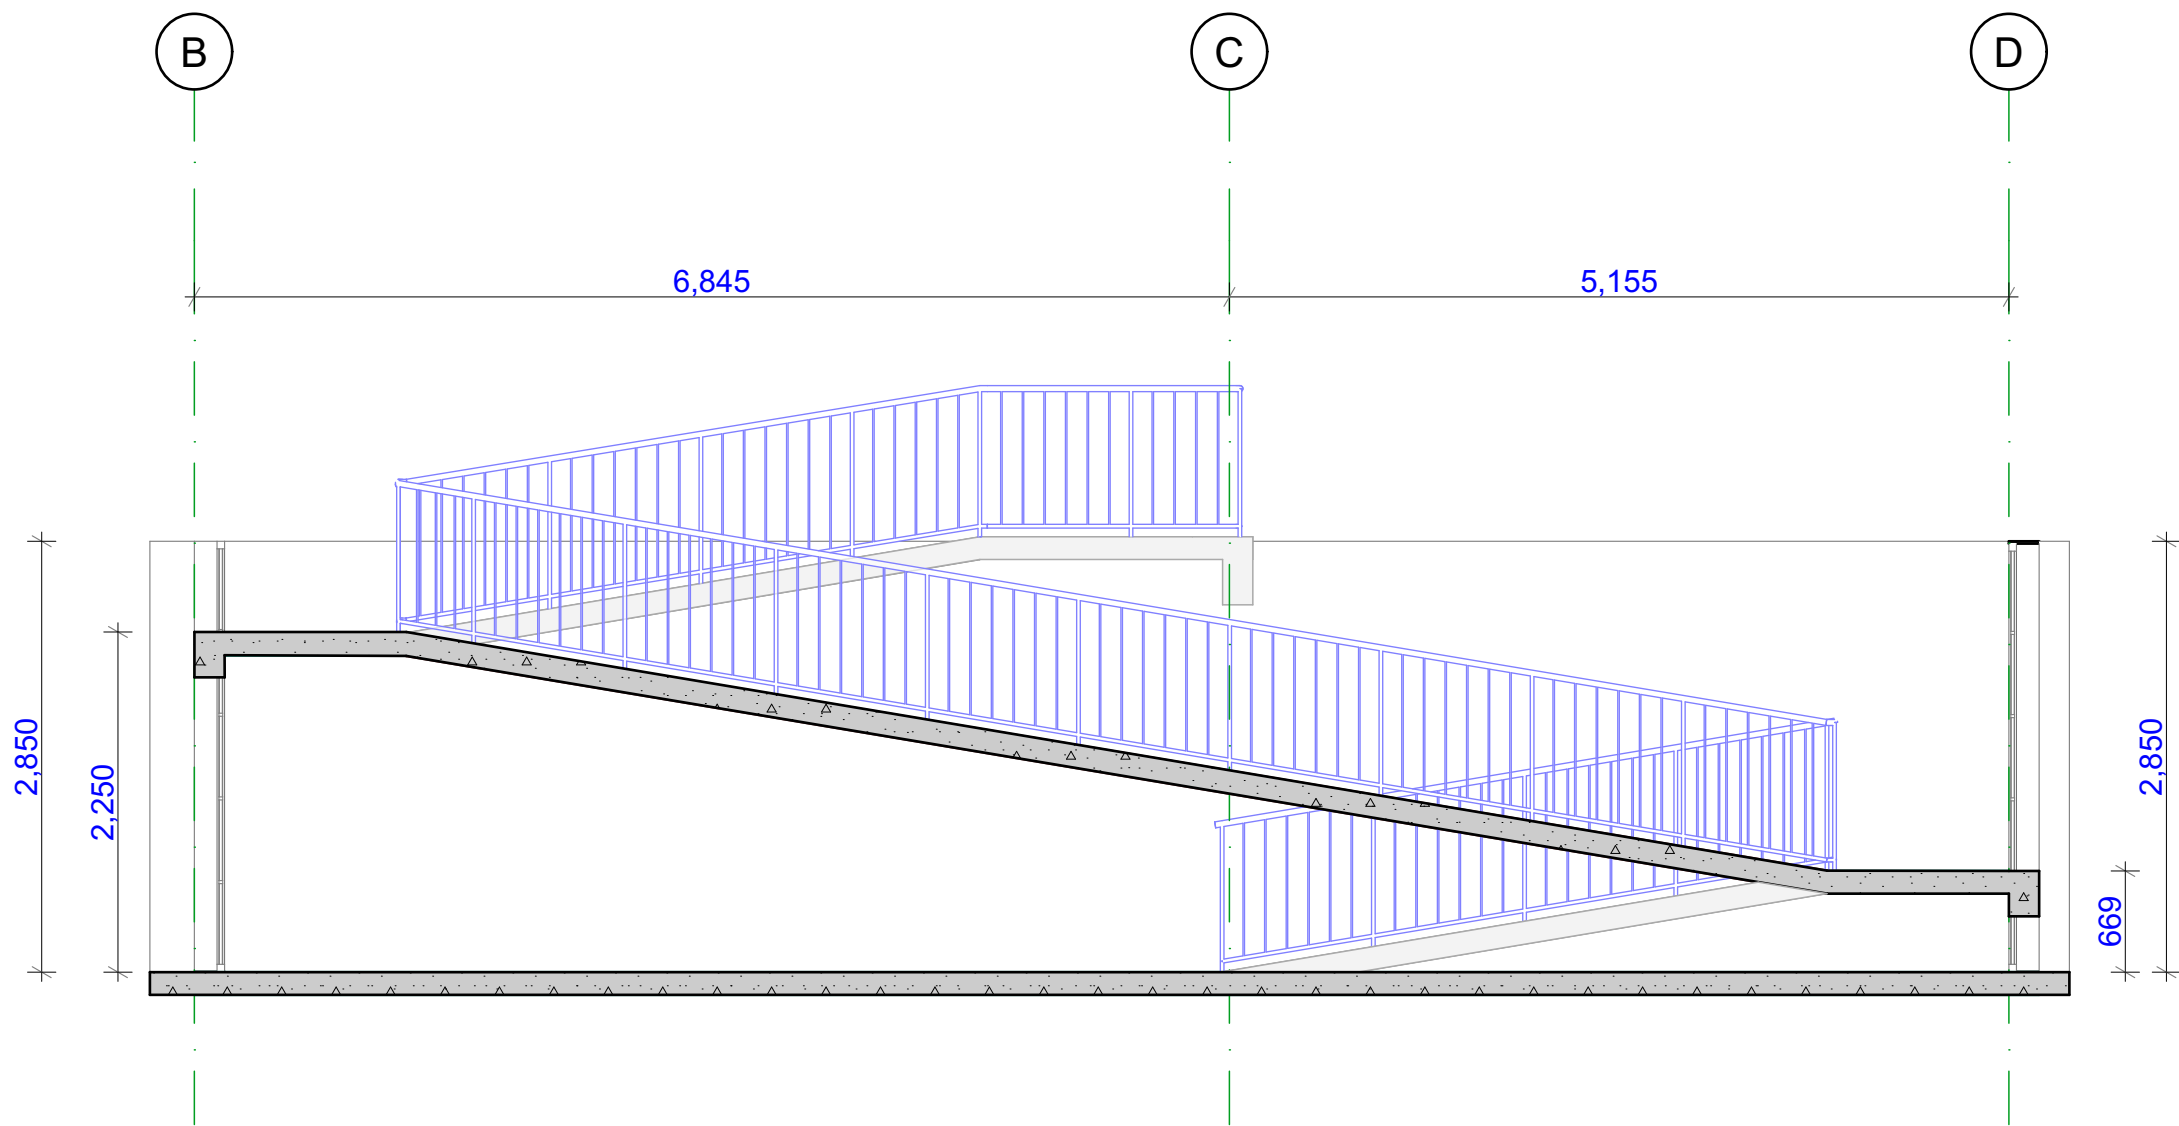

Ramp Section S-B1
Scale 1:50

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations.

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

RAMP


JOB NO

DRG.NO


A108

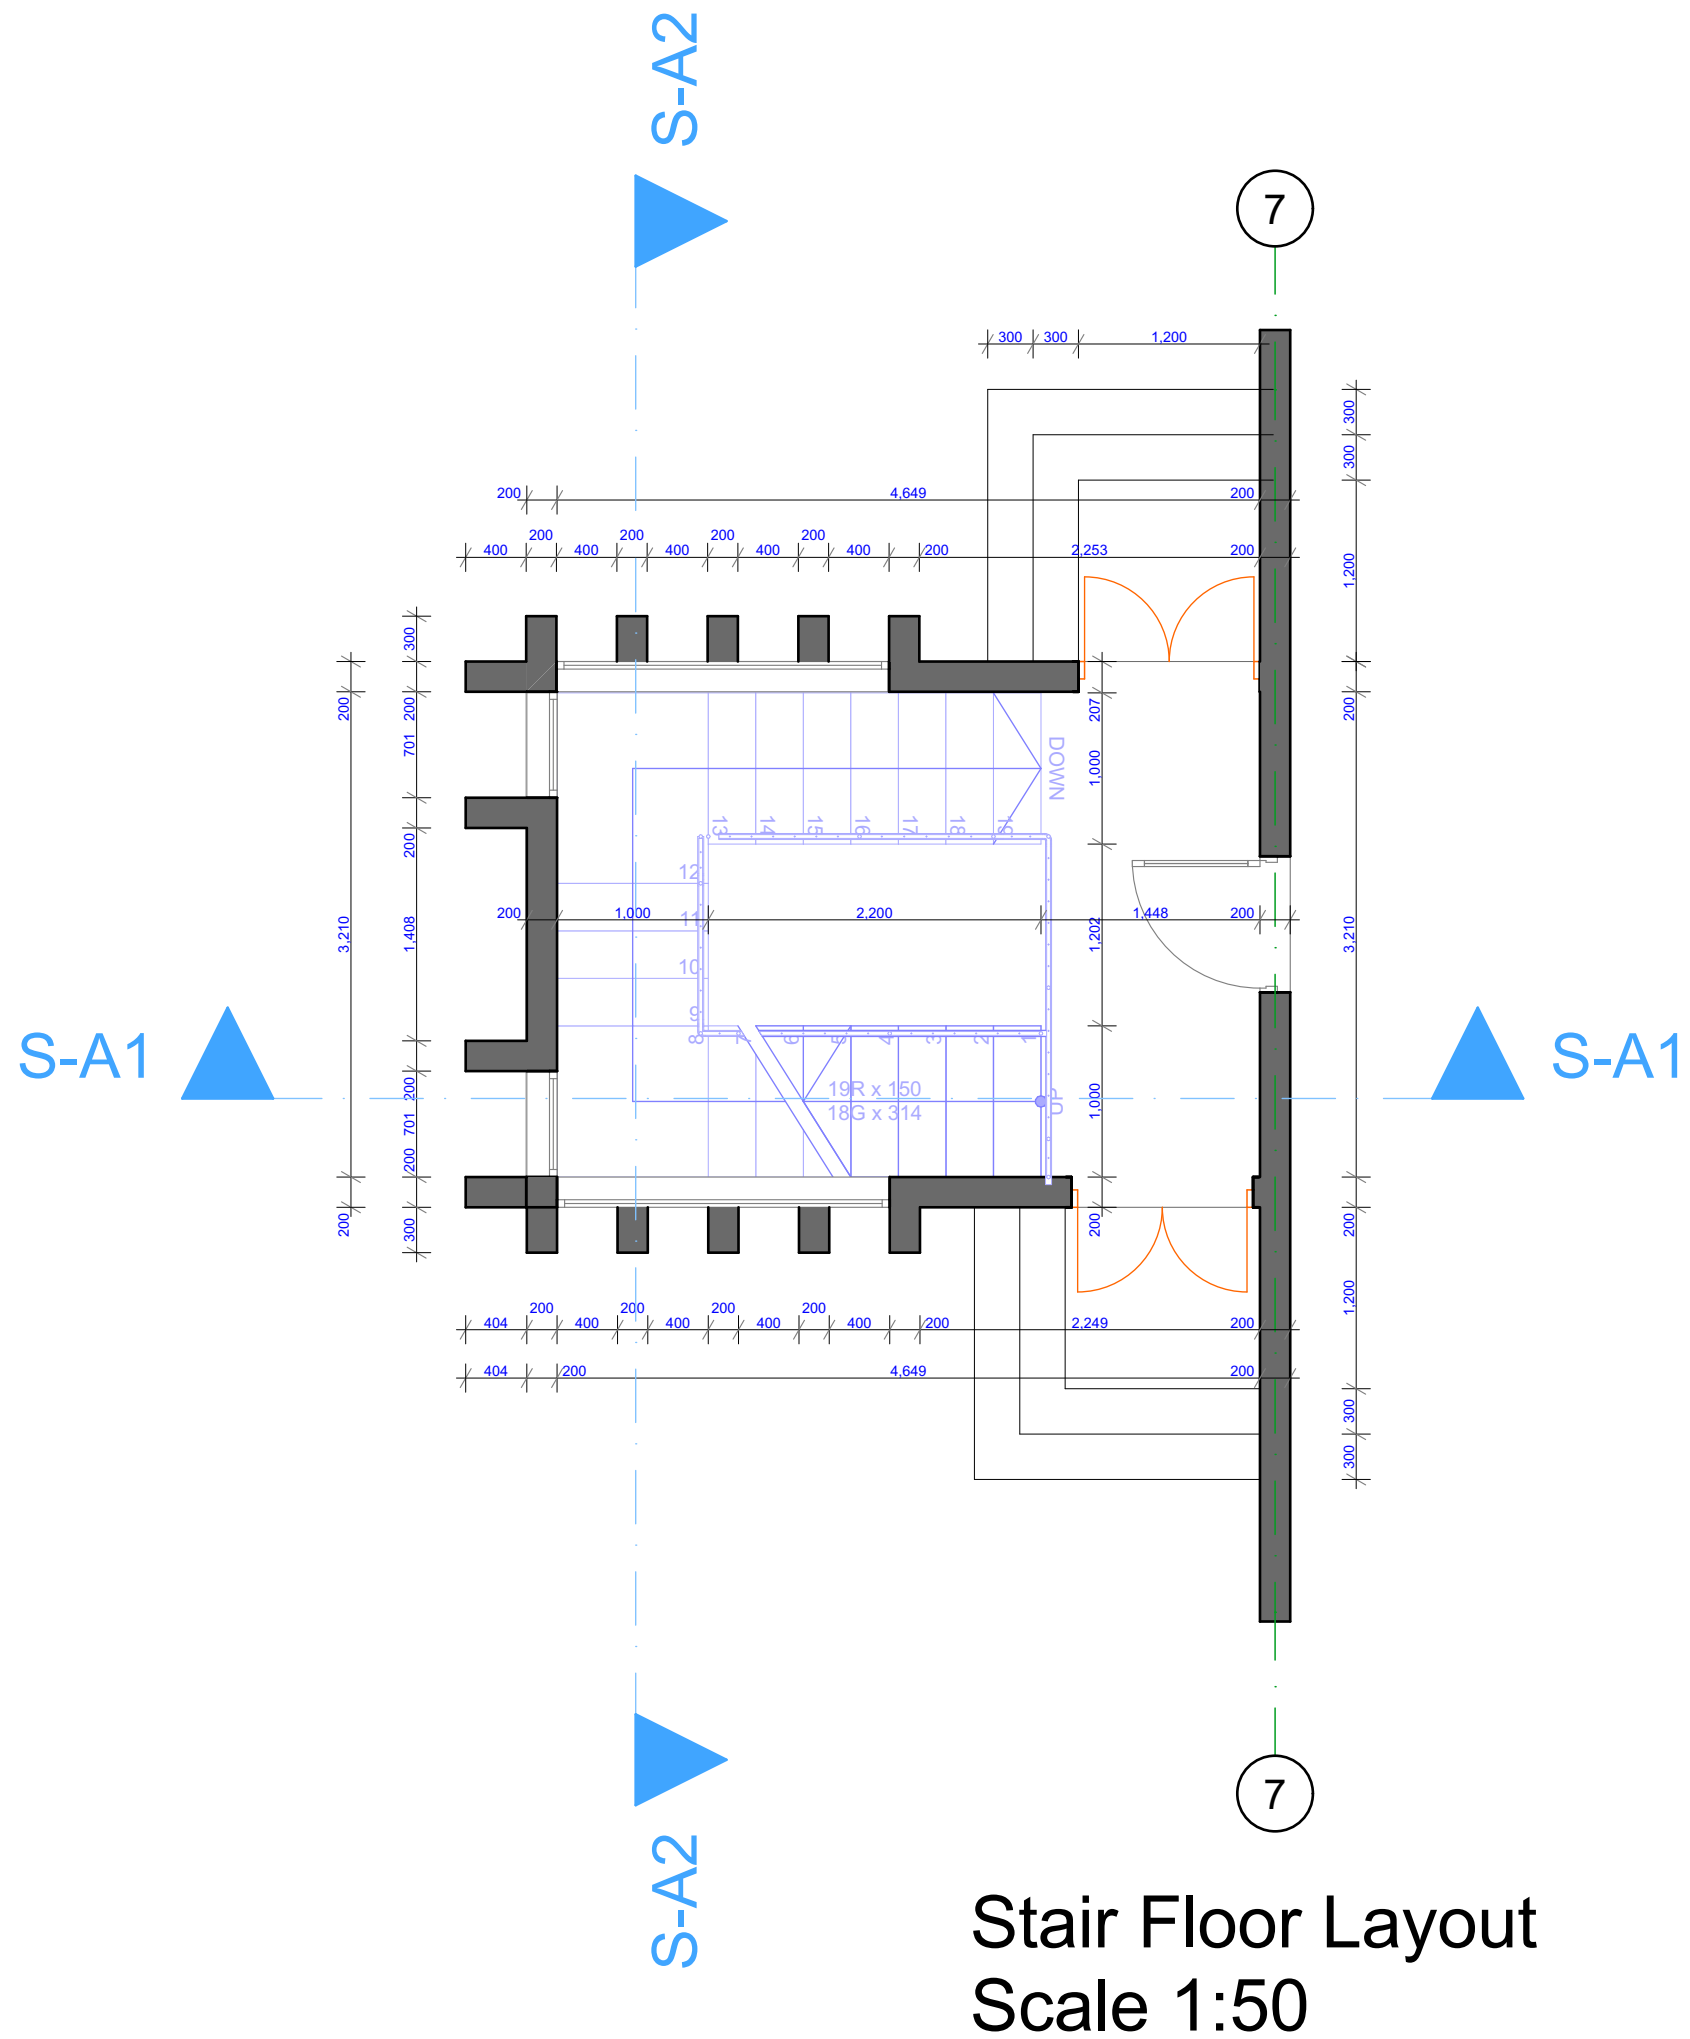

Stair Floor Layout
Scale 1:50

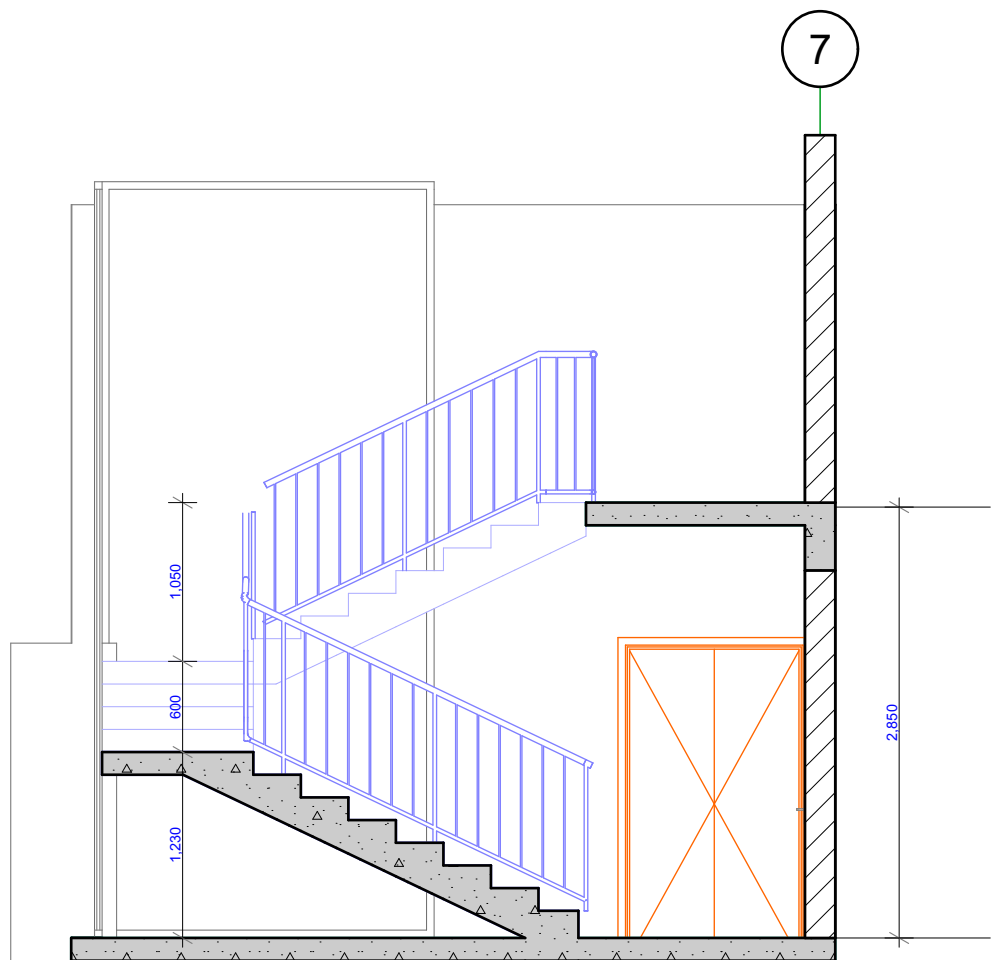

Stair Section S-A1
Scale 1:50

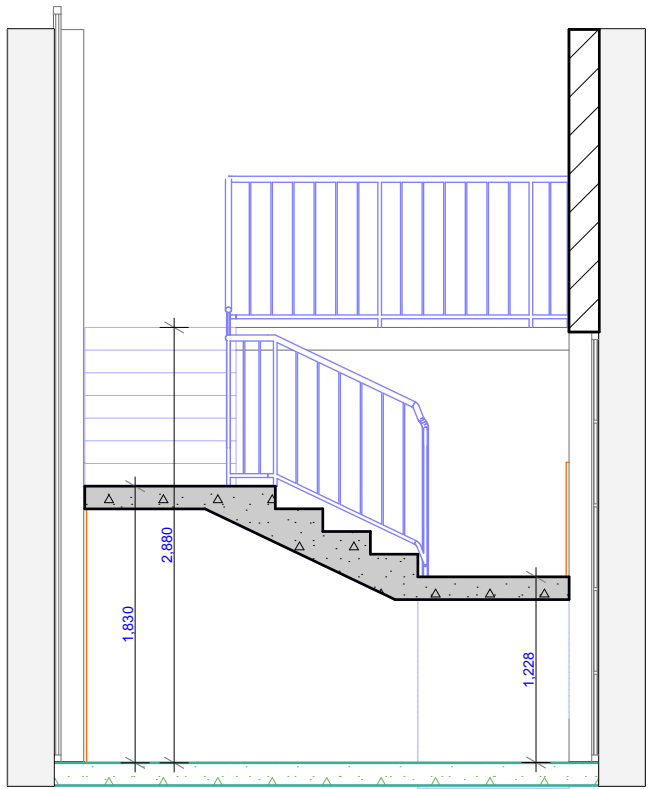

Stair Section S-A2
Scale 1:50

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated.
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

STAIR

JOB NO

DRG.NO

A109



NOTES

- GENERAL NOTES**
- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
 - 2 Read only figured dimensions .
 - 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations .
 - 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
 - 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
 - 6 Water Meter to be 300mm above G.L.
 - 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
 - 8 All R.C. works to structural engineer's details.
 - 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
 - 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
 - 11 All levels shown are finished levels unless otherwise stated.
 - 12 All surface beds to be cast on well compacted and well consolidated filling .
 - 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
 - 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN _____

DATE _____

PROJECT


Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

JOB NO	DRG.NO
	A110

TILING LAYOUT

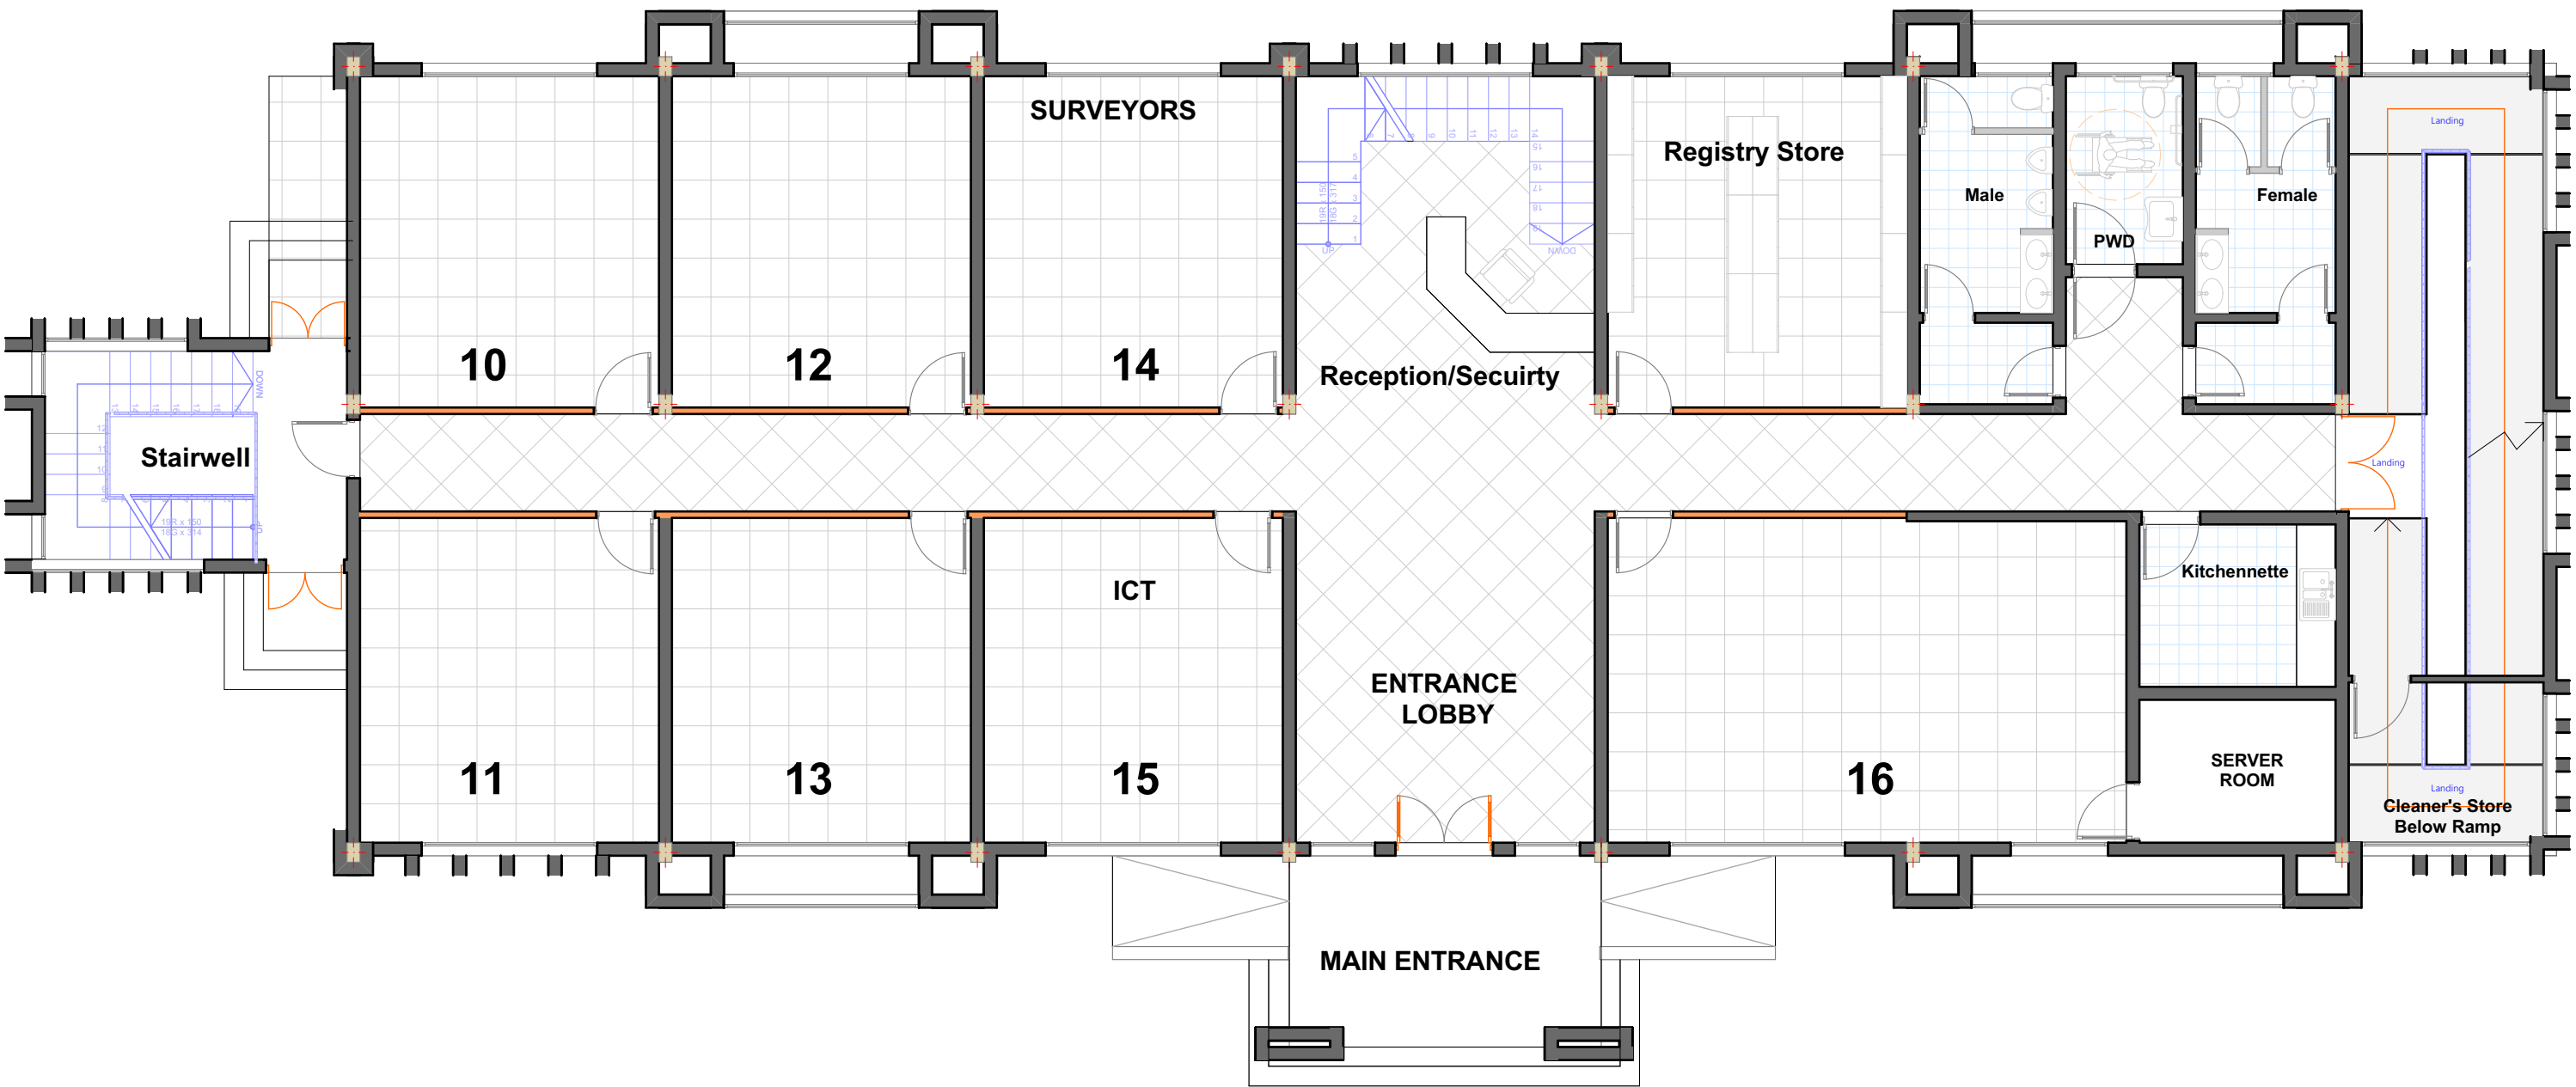

Ground Floor Plan
Scale 1:100

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

GROUND FLOOR

JOB NO

DRG.NO

A111

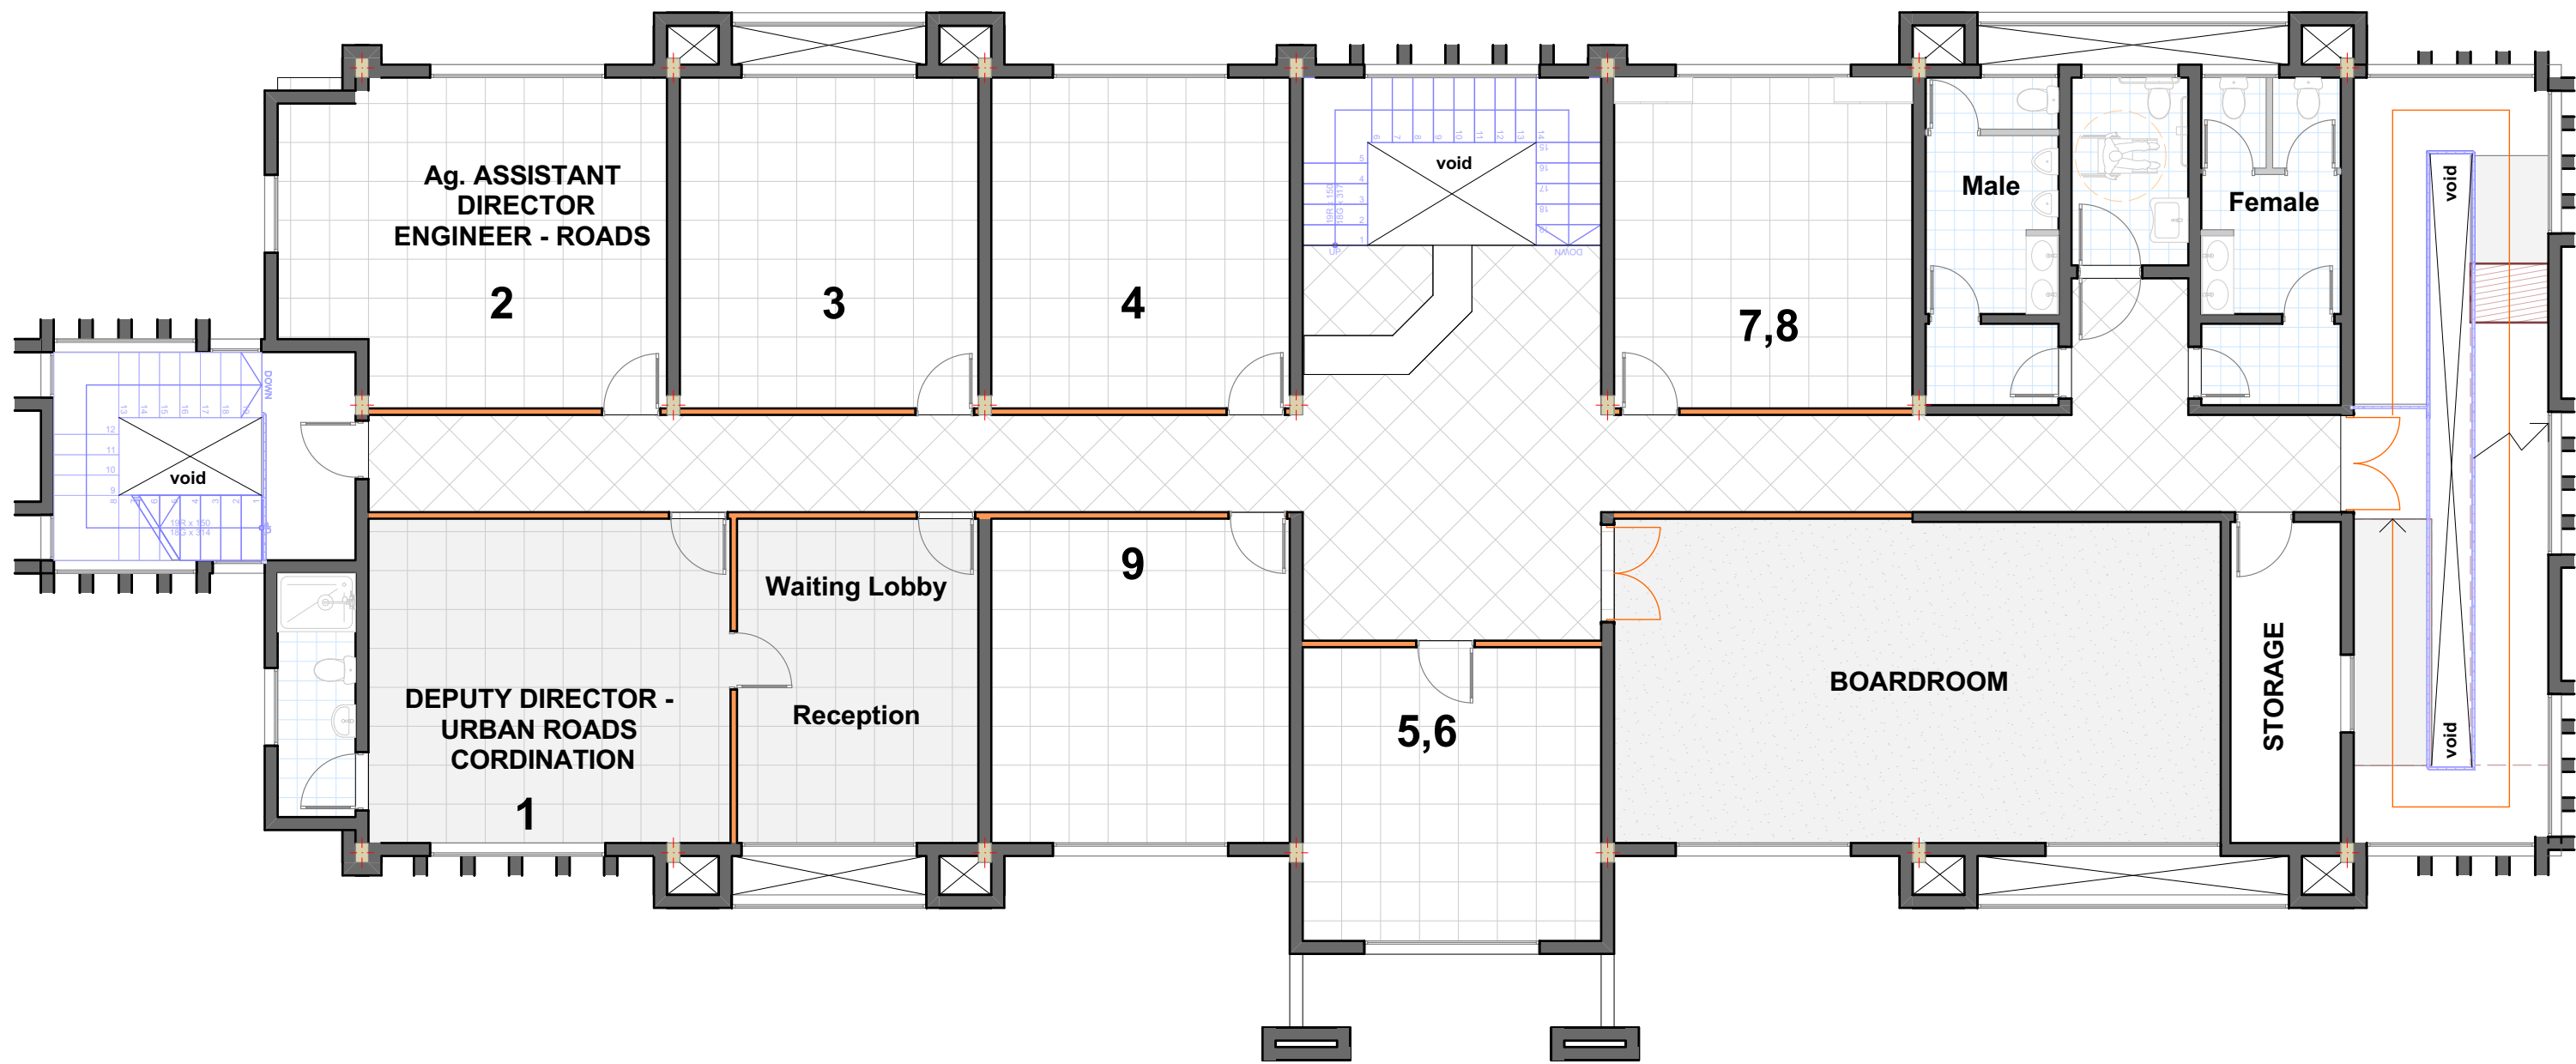

First Floor Plan
Scale 1:100

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)
SIGN _____

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

FIRST FLOOR

JOB NO

DRG.NO

A112

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations.
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast concrete paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated .
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

[illegible]

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE _____

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _


DRAWING TITLE

SECOND FLOOR

JOB NO	DRG.NO
--------	--------

DRG.NO

A113

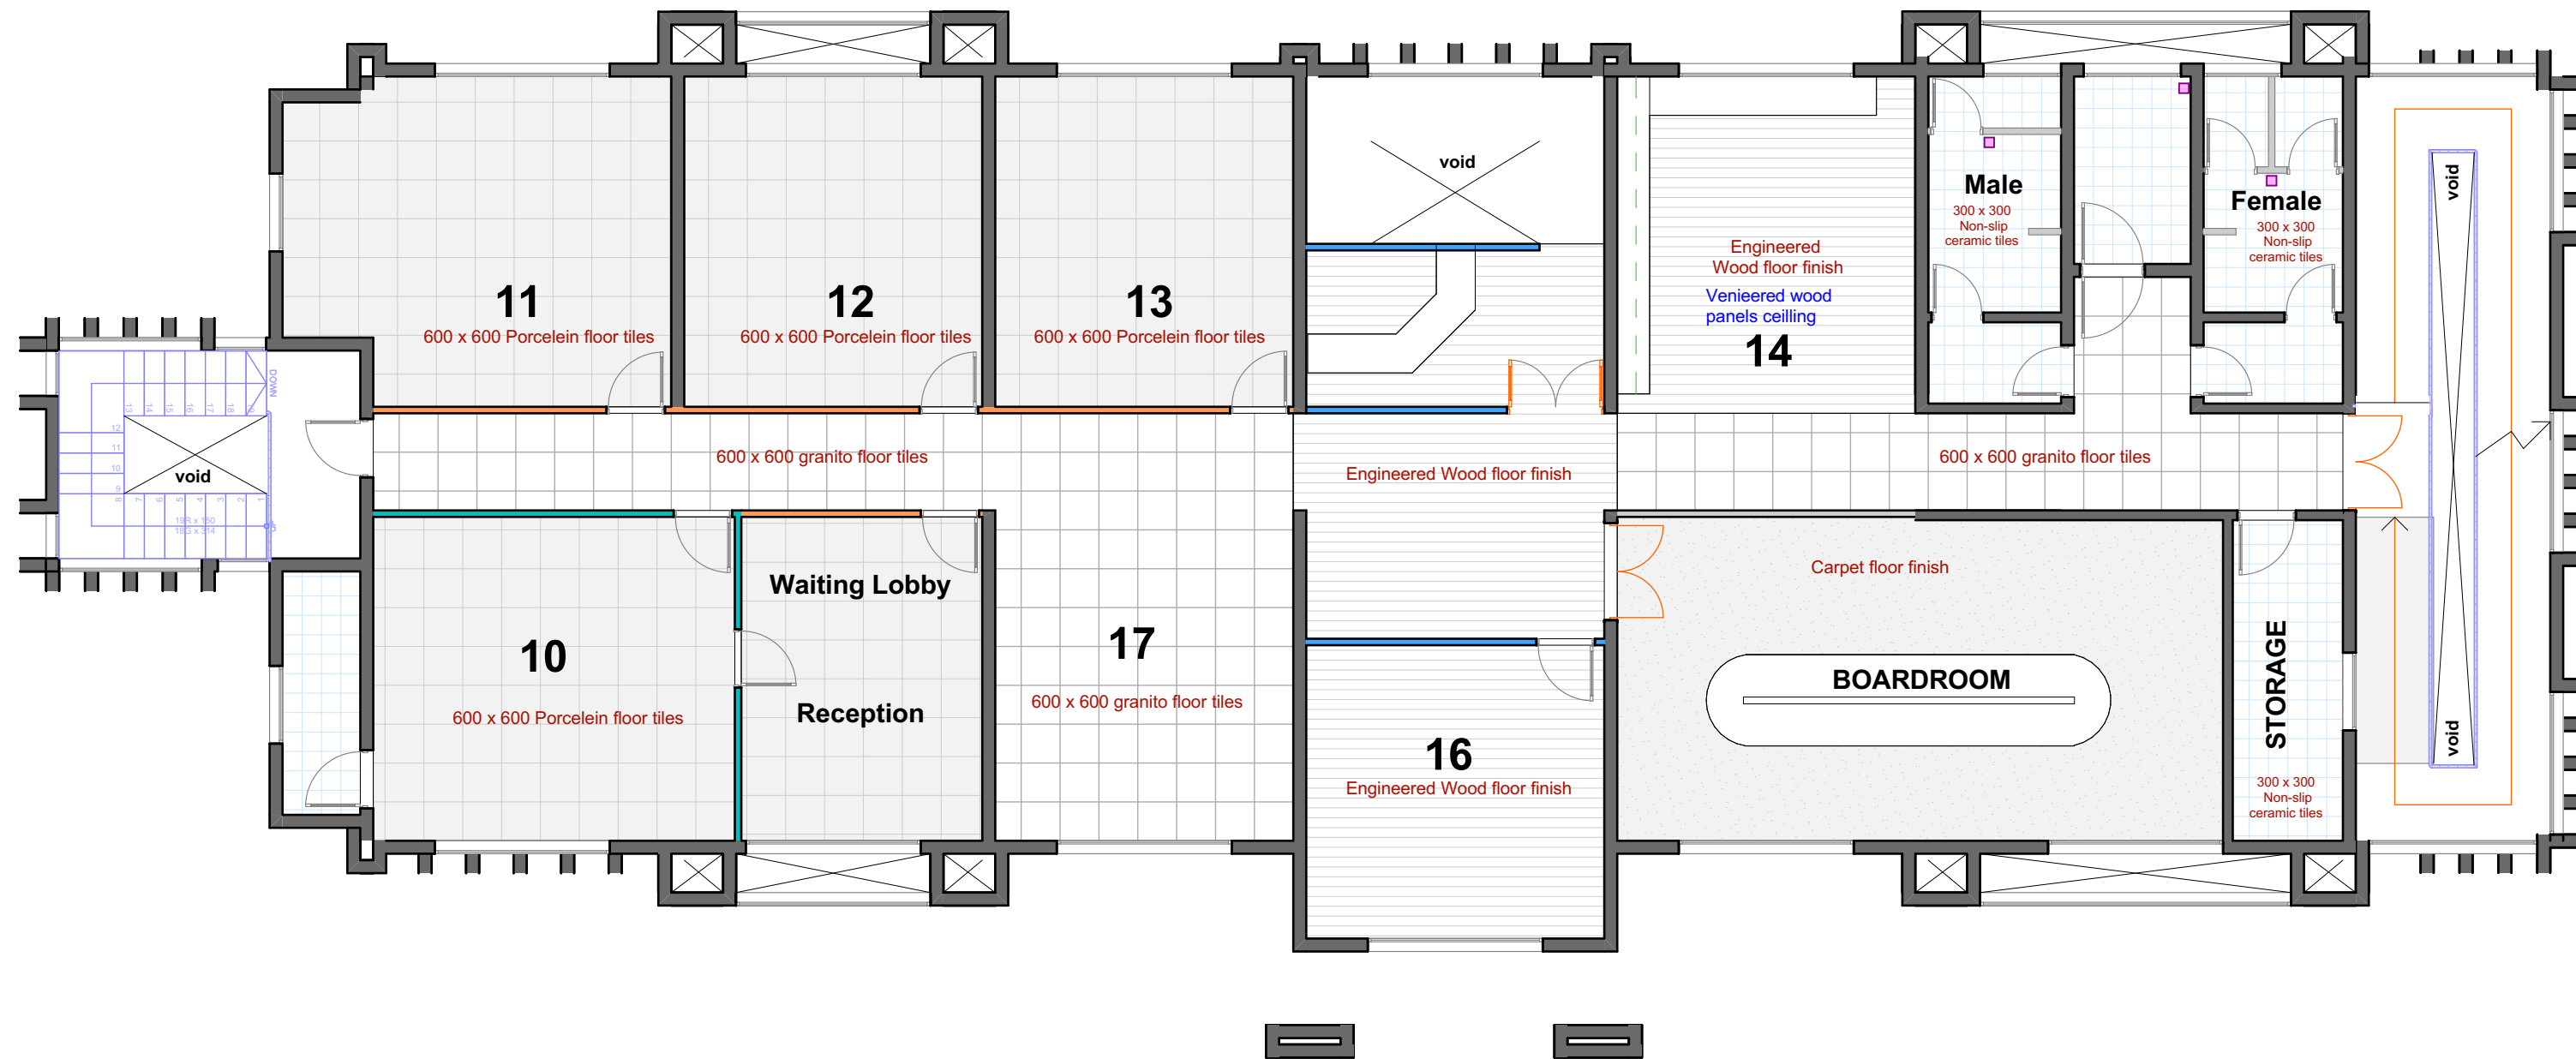

Second Floor Plan

Scale 1:100

OPENING SCHEDULES

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated.
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

GROUND FLOOR

JOB NO


DRG.NO


B100

E-3

E-1

Ground Floor Plan
Scale 1:100

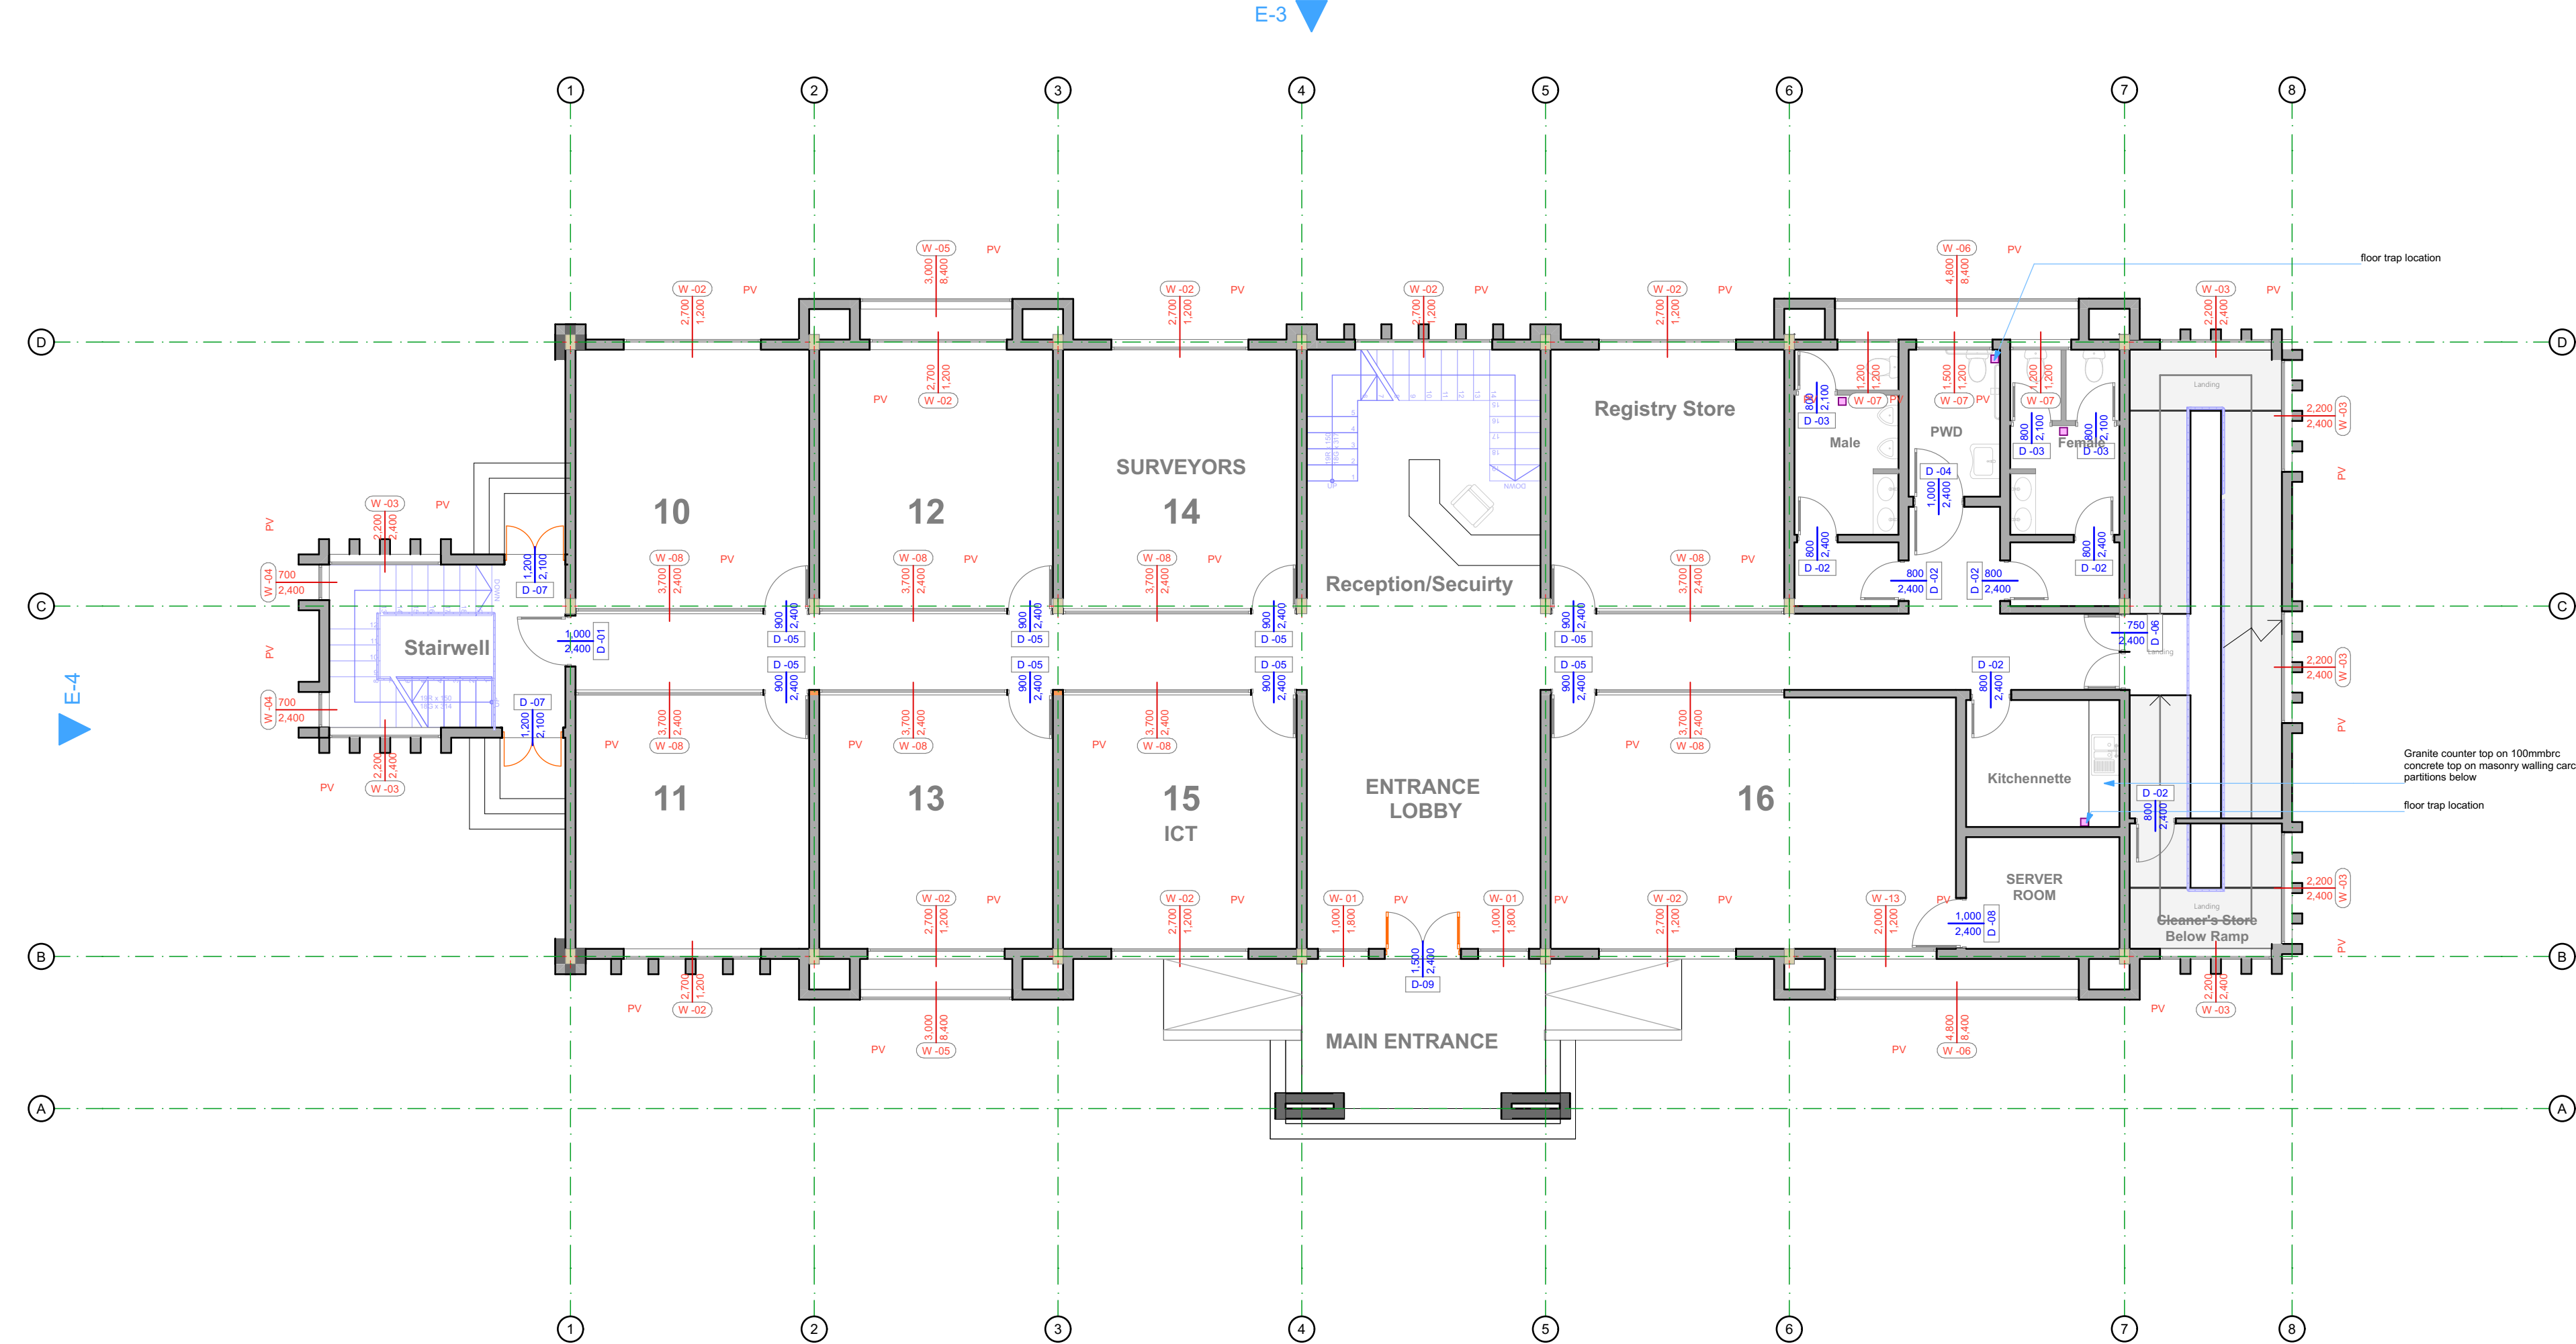

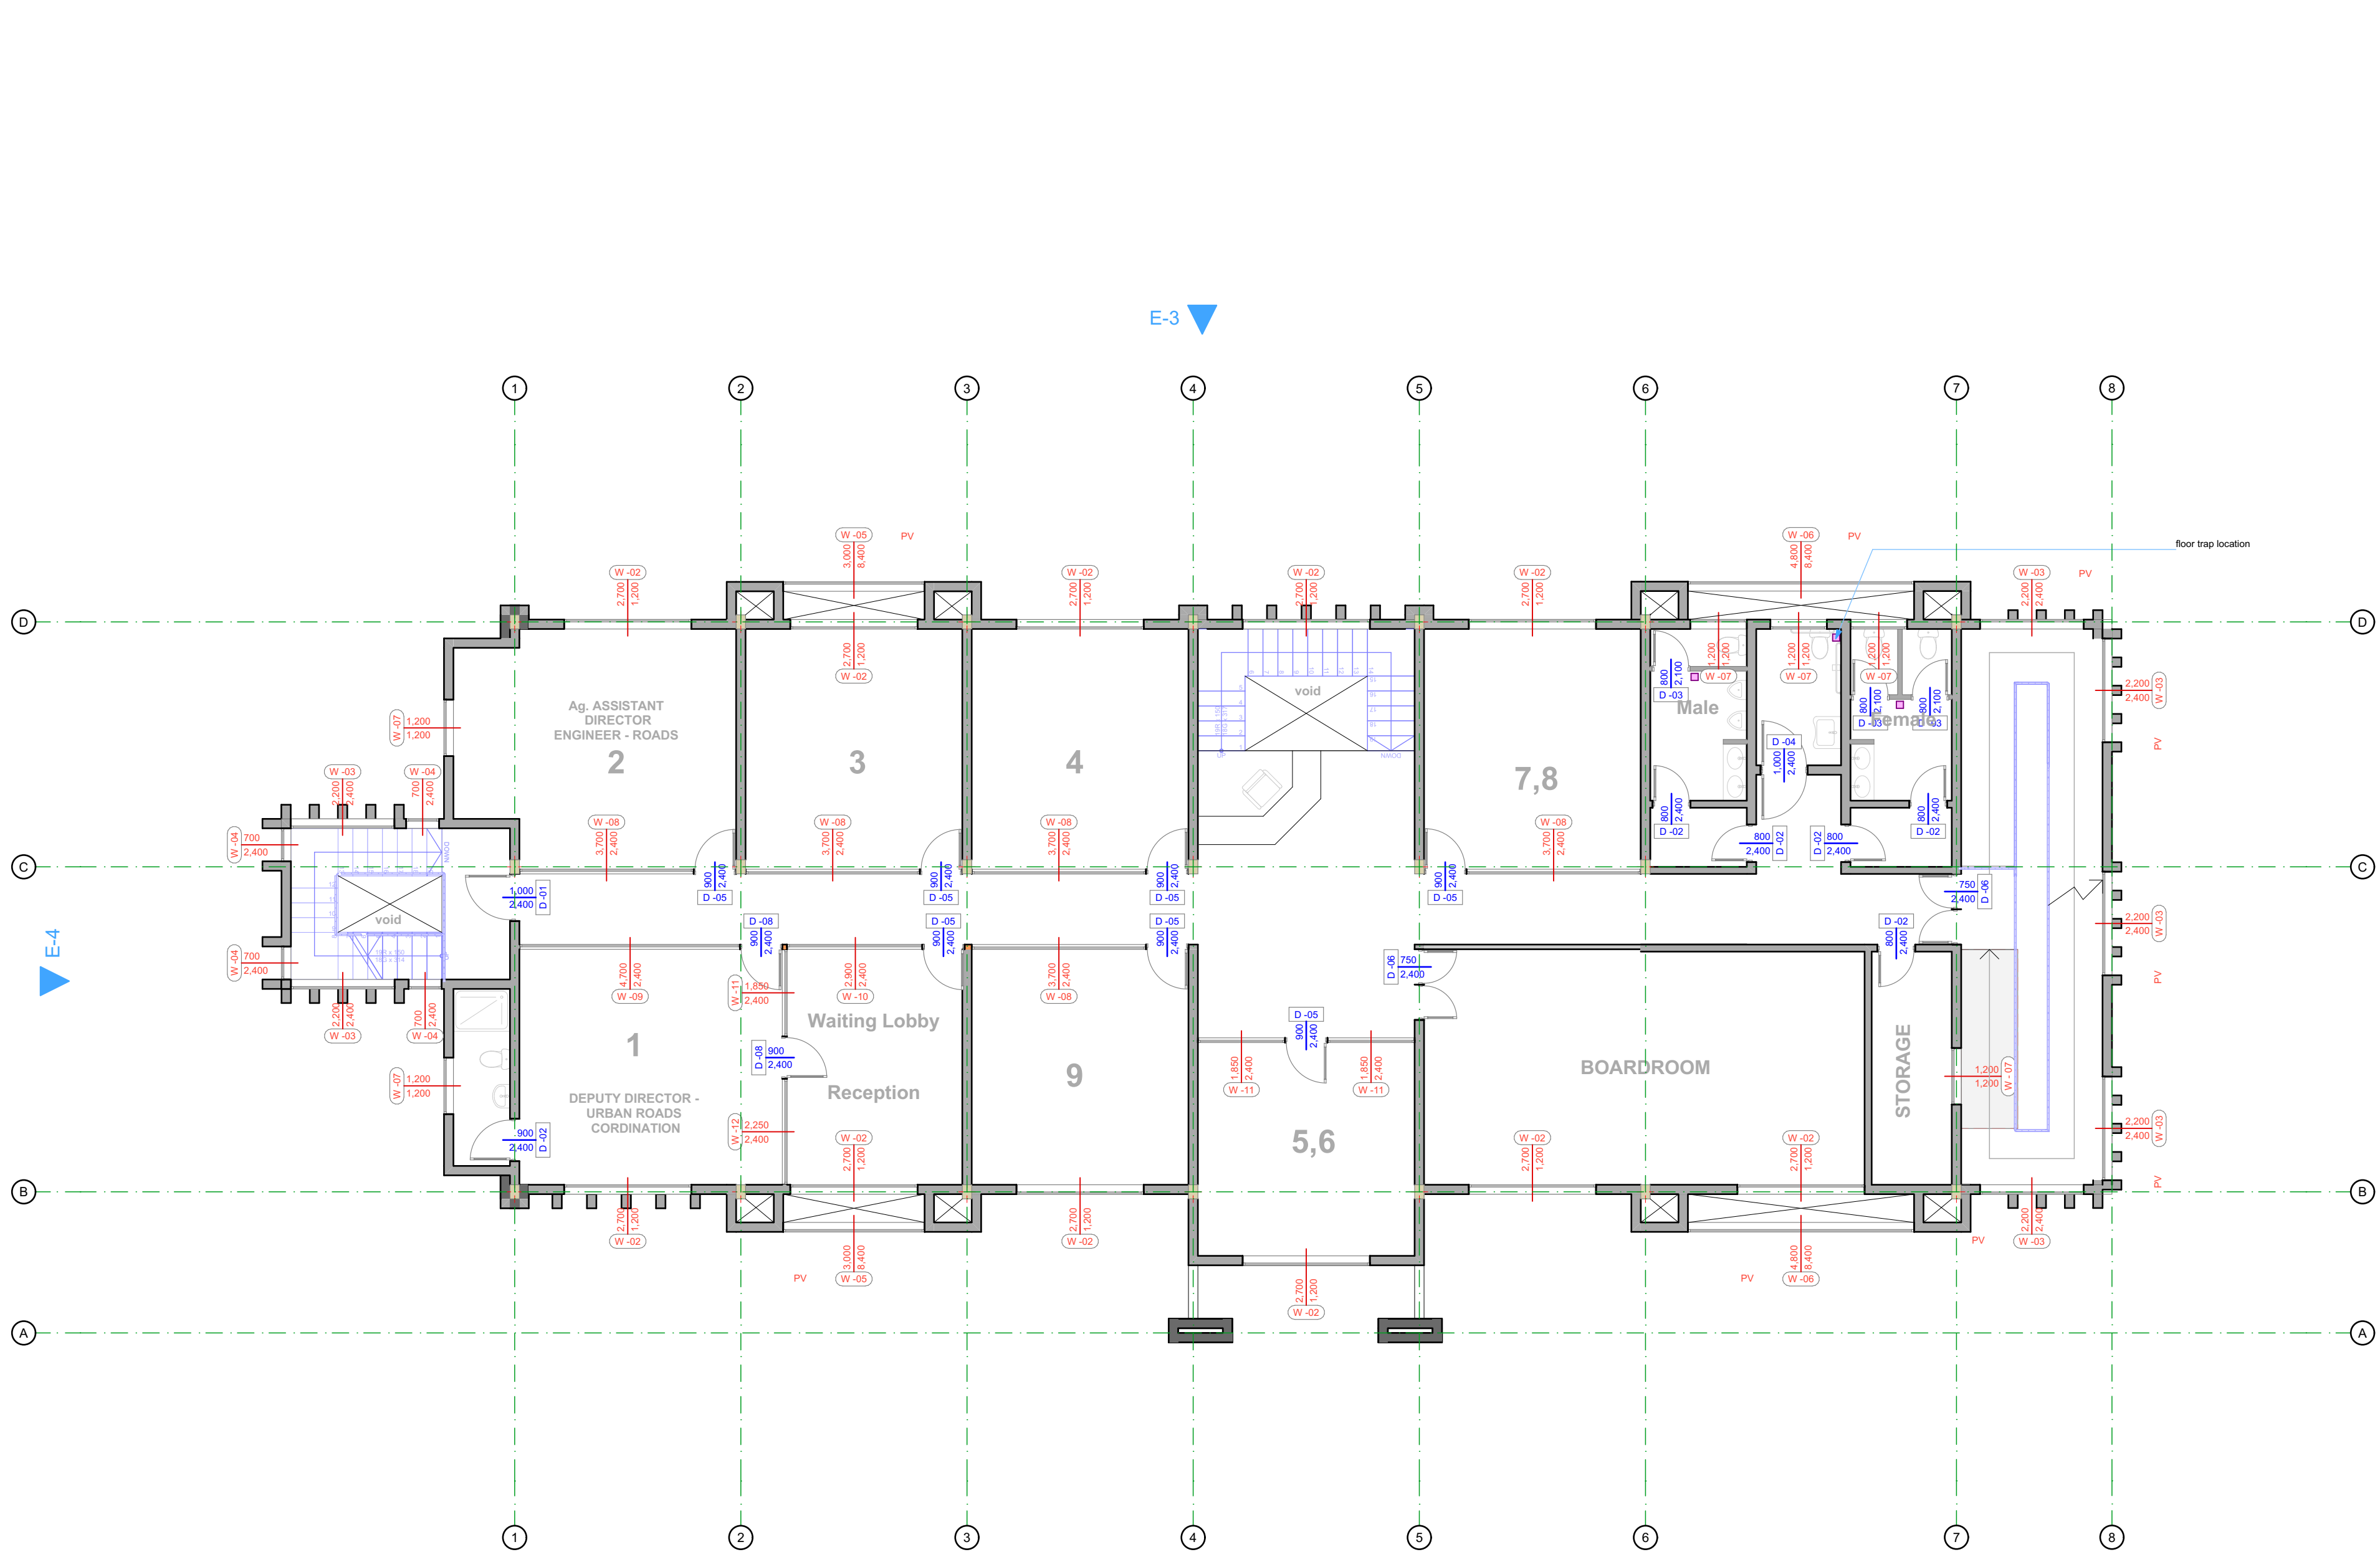

NOTES

- GENERAL NOTES**
- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
 - 2 Read only figured dimensions .
 - 3 All construction work is to comply with the latest K.B.S. standard codes of practice, Local Authority By-Laws, and Fire regulations.
 - 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
 - 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
 - 6 Water Meter to be 300mm above G.L.
 - 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
 - 8 All R.C. works to structural engineer's details.
 - 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
 - 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
 - 11 All levels shown are finished levels unless otherwise stated.
 - 12 All surface beds to be cast on well compacted and well consolidated filling .
 - 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
 - 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN _____

DATE _____

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

FIRST FLOOR

JOB NO	DRG.NO
	B101

First Floor Plan
Scale 1:100

NOTES

GENERAL NOTES

- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
- 2 Read only figured dimensions .
- 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
- 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
- 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
- 6 Water Meter to be 300mm above G.L.
- 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
- 8 All R.C. works to structural engineer's details.
- 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
- 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
- 11 All levels shown are finished levels unless otherwise stated.
- 12 All surface beds to be cast on well compacted and well consolidated filling .
- 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
- 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

SECOND FLOOR

JOB NO

DRG.NO

B102


E-3



E-2



E-4

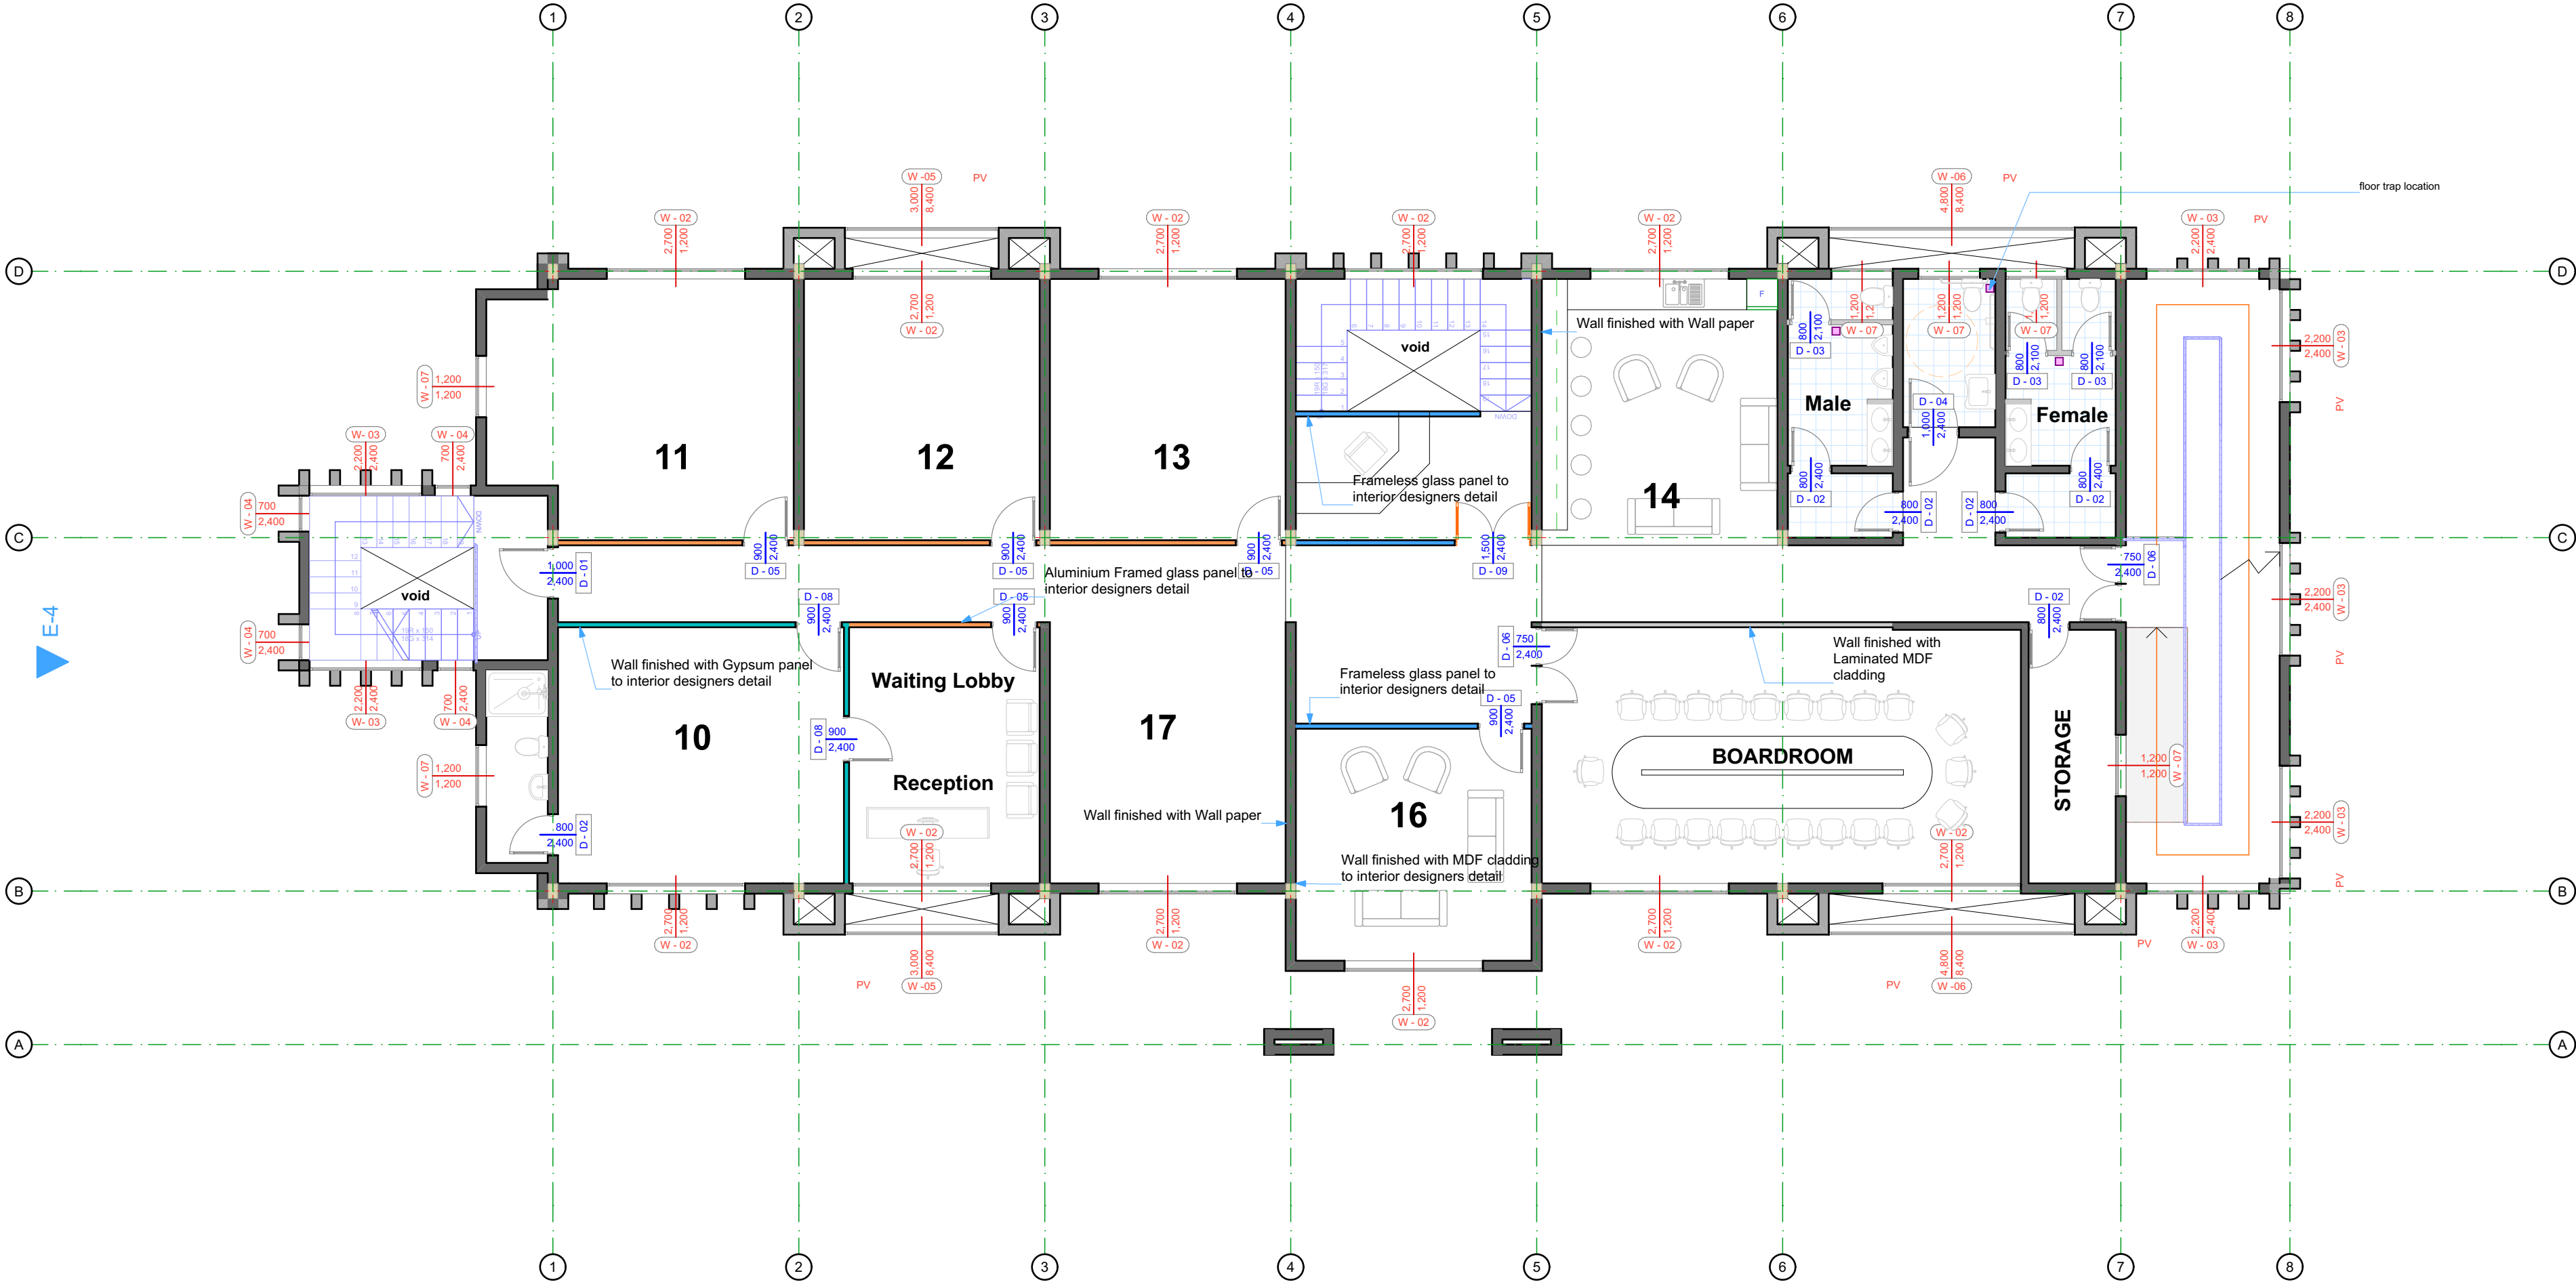

Second Floor Plan
Scale 1:100

NOTES

- GENERAL NOTES
- 1 This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .
 - 2 Read only figured dimensions .
 - 3 All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .
 - 4 P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown
 - 5 All walls less than 200mm thick to be reinforced with hoop iron at every alternate course
 - 6 Water Meter to be 300mm above G.L.
 - 7 D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.
 - 8 All R.C. works to structural engineer's details.
 - 9 Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .
 - 10 Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .
 - 11 All levels shown are finished levels unless otherwise stated.
 - 12 All surface beds to be cast on well compacted and well consolidated filling .
 - 13 Depth of foundation trenches to be minimum 600mm below reduced ground level .
 - 14 All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS		
No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN _____

DATE _____

PROJECT


Proposed Offices in Lower Eastern Region,
Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

ROOF

JOB NO	DRG.NO
	B103

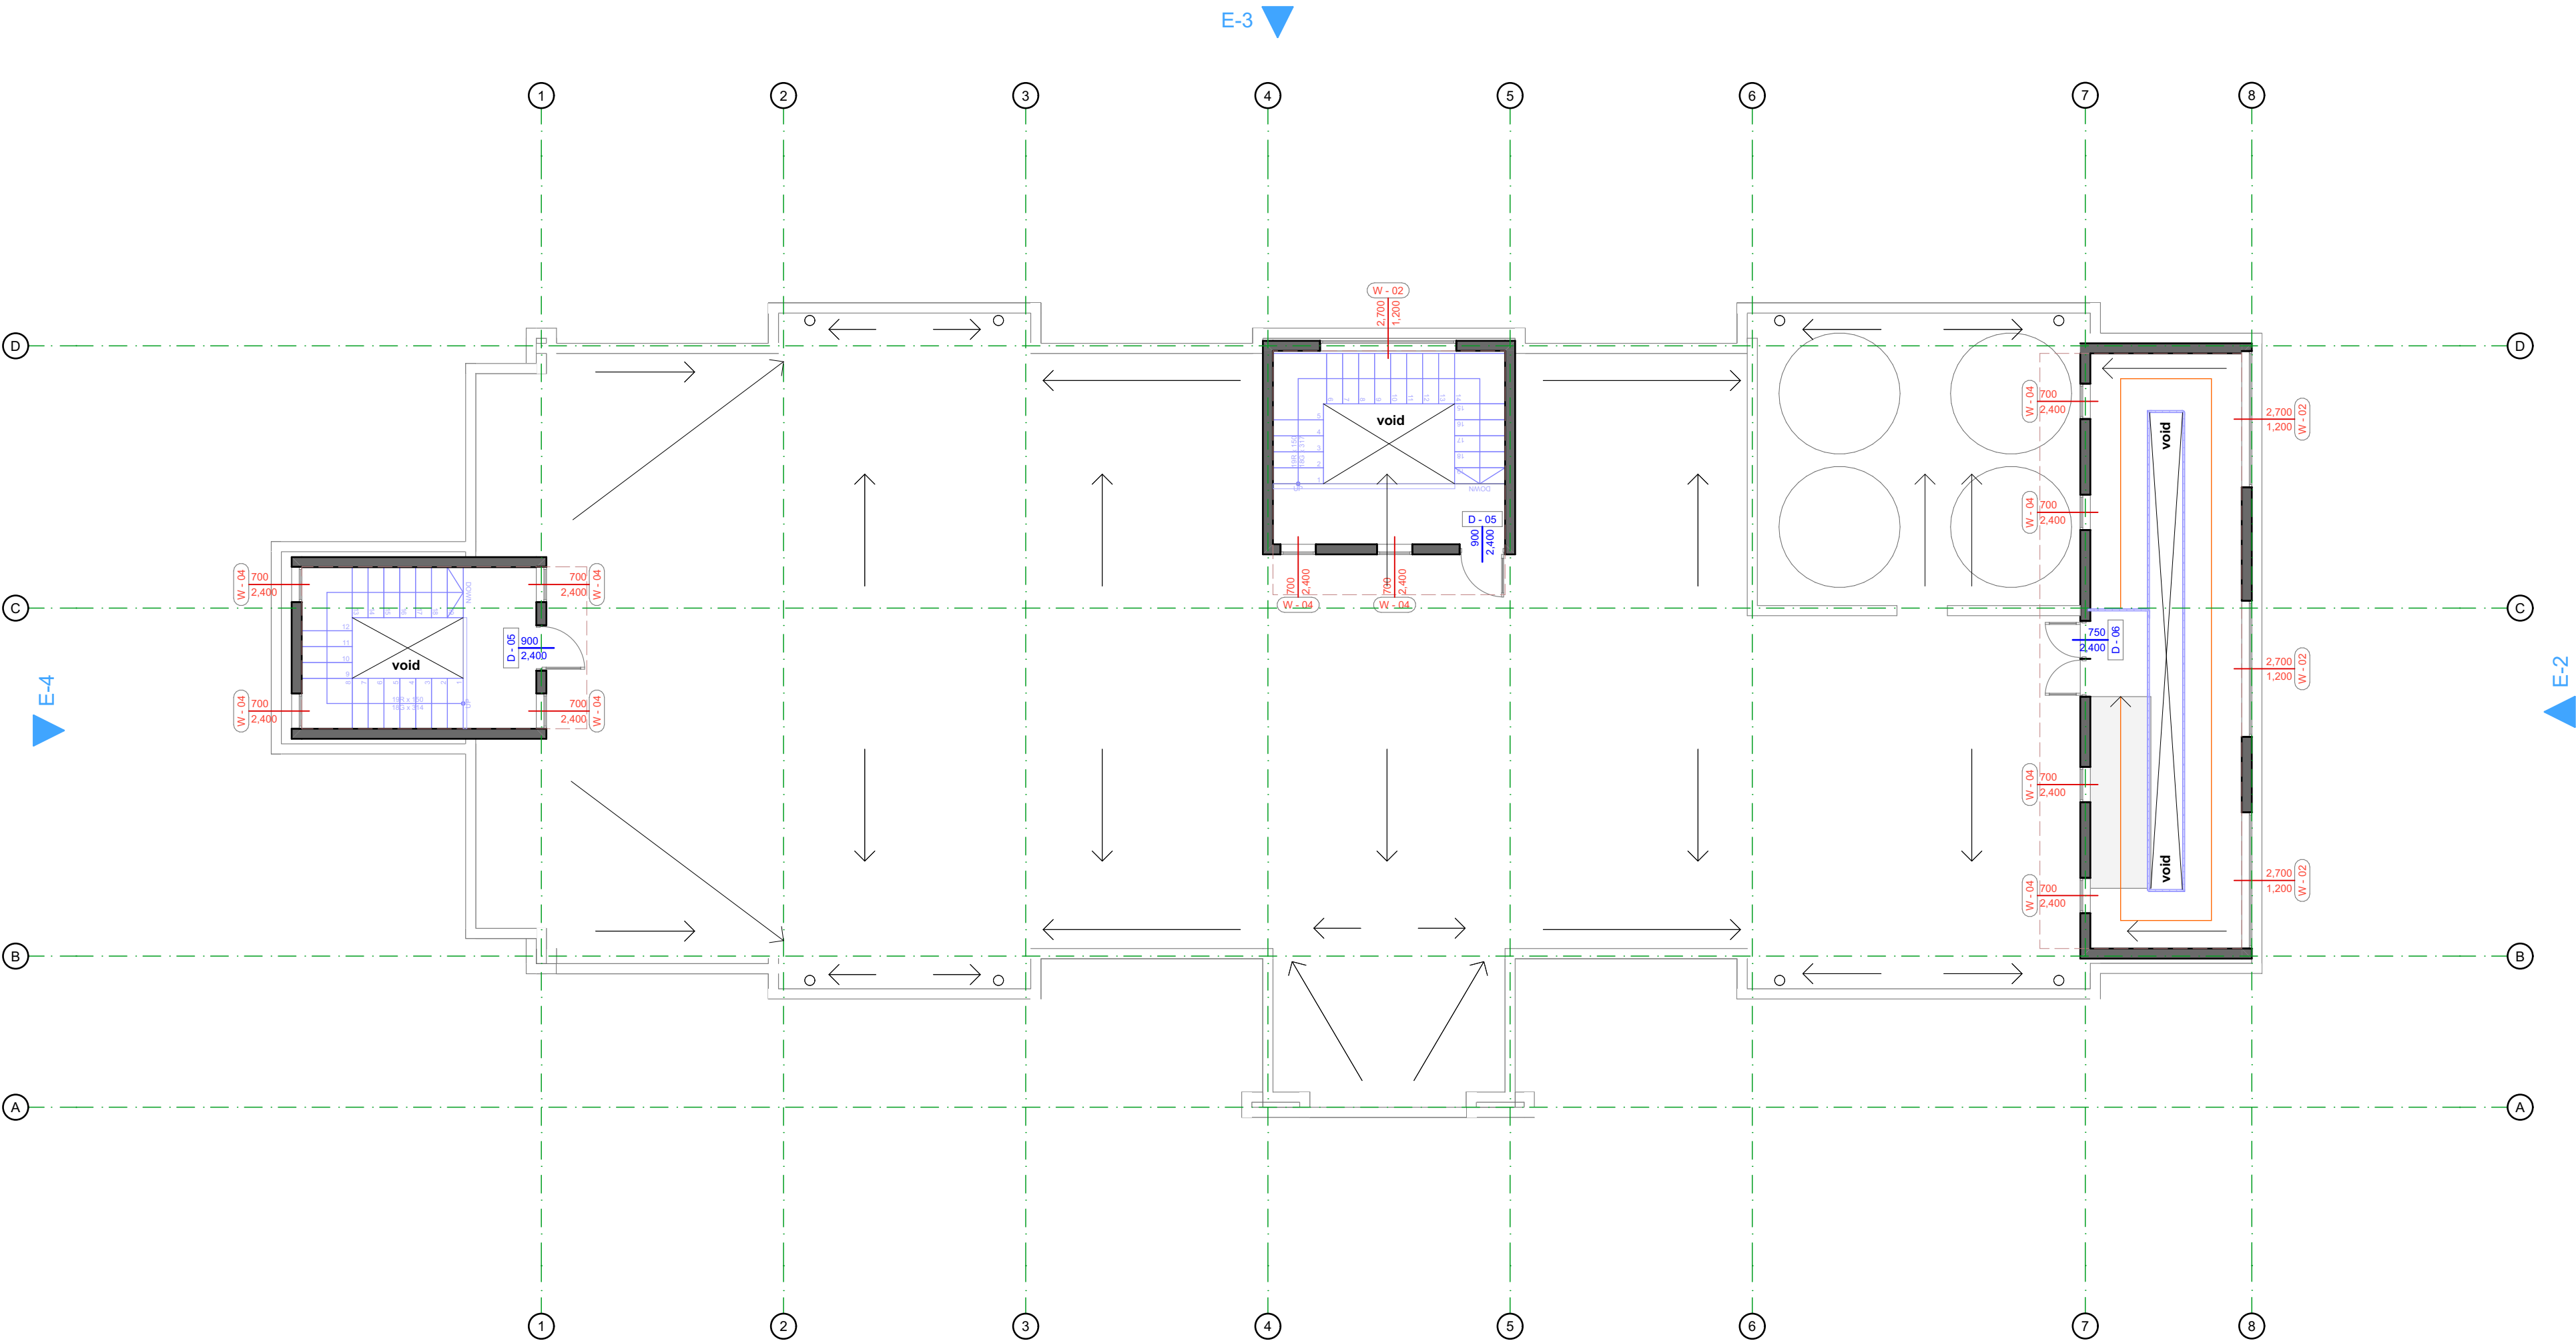

Roof Plan
Scale 1:100

Elevation					
	Door ID	D - 01	D - 02	D - 03	D - 04
	Size	1000 x 2400	800 x 2400	800 x 1800	1000 x 2400
	Quantity	3	18	9	3
	Description	Fire Door to manufacturers specification and Architects Approval Provide Door closer and rubber door stop	Solid Core flush door with 4MM glass view panel to suppliers specification and Architect's Approval Provide Door closer and rubber door stop	Solid Core flush door to suppliers specification and Architect's Approval	Solid Core flush door to suppliers specification and Architect's Approval Provide Door closer and rubber door stop

Elevation				
	Door ID	D - 05	D - 06	D - 07
	Size	900 x 2400	1500 x 2400	1200 x 2400
	Quantity	22	7	2
Description	Powder coated aluminium door with 6MM Laminated glass infil to suppliers specification and Architect's Approval			
	Provide Door closer and rubber door stop with pv			

DOOR SCHEDULE

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY
P.O. BOX 41727 - 00100

DIRECTOR (RACM)
SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County



SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

JOB NO

DRG.NO

B104

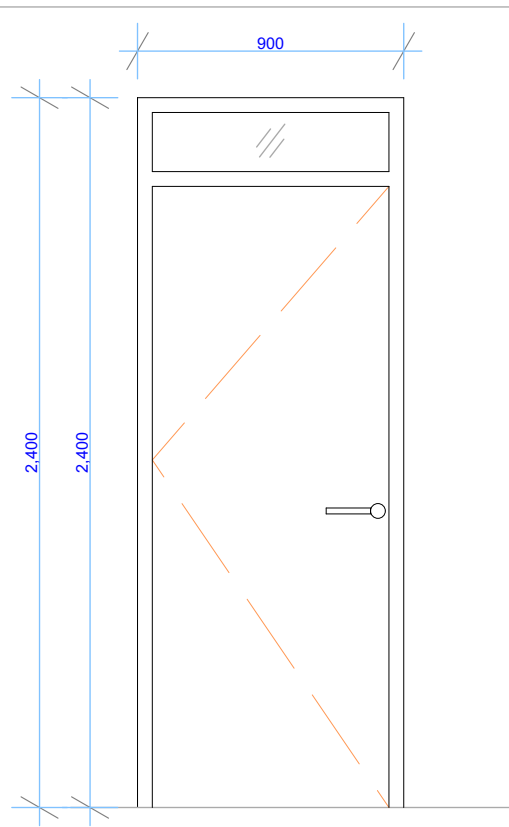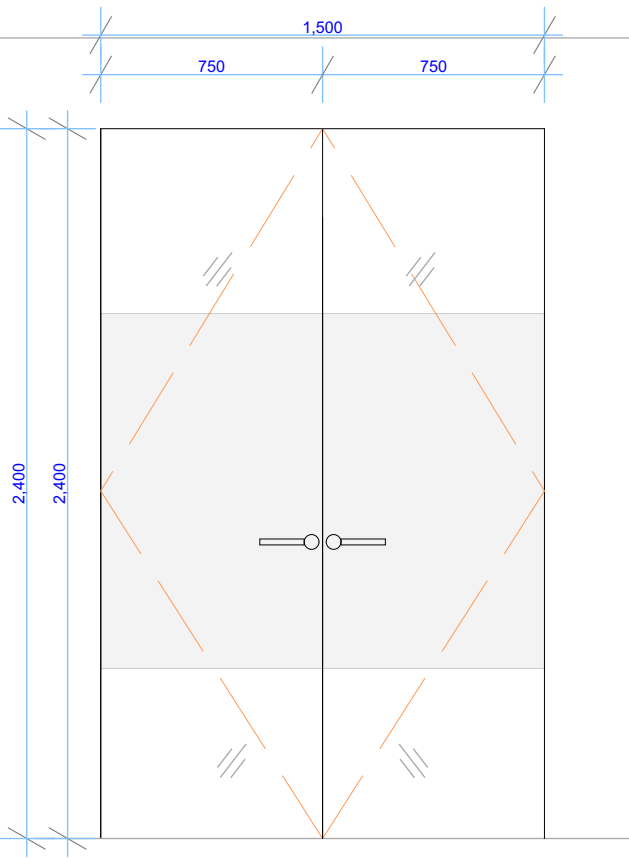Elevation			
	Door ID	D - 08	D - 09
	Size	900 x 2400	1500 x 2400
	Quantity	4	2
	Description	Solid Mahogany Door to suppliers specification and Architect's Approval Provide Door closer and rubber door stop with pv	

DOOR SCHEDULE

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County




SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

JOB NO

DRG.NO

B105

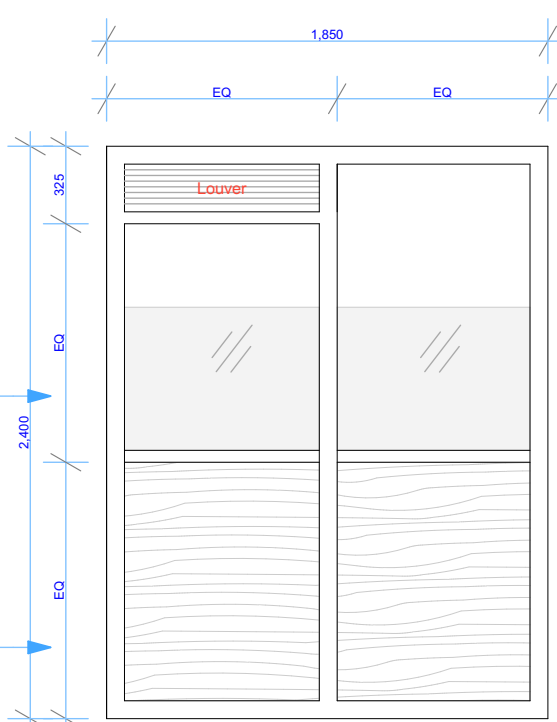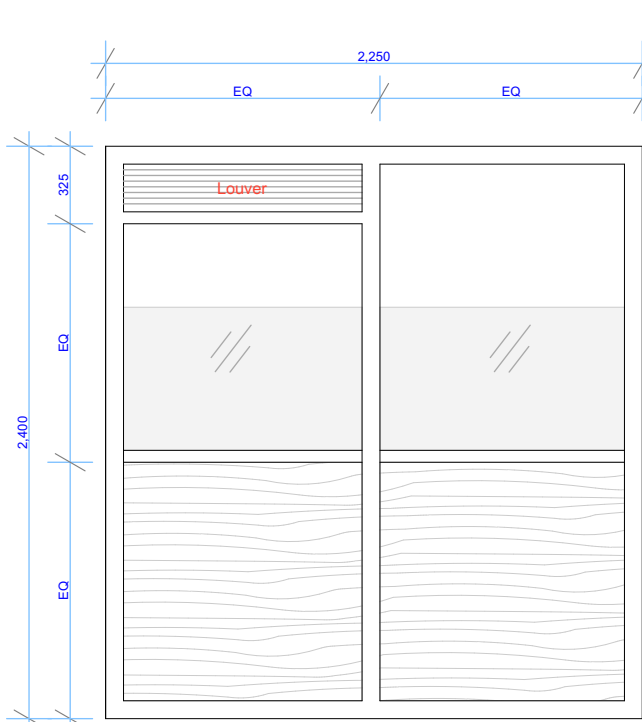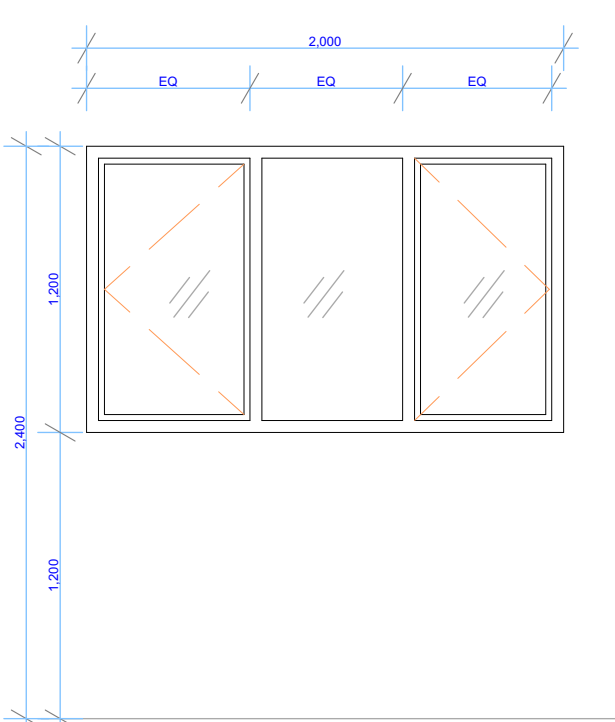Elevation with KURA print (refer to Offices at bara bara plaza) look laminate KURA's Offices a bara plaza)			
	Window ID Size Quantity	W - 11 1850 x 2400 3	W - 12 2250 x 2400 1
Description	Powder coated aluminium window with 6MM Laminated glass infil to suppliers specification and Architect's Approval	Powder coated aluminium window with 6MM Laminated glass infil to suppliers specification and Architect's Approval	Powder coated aluminium window with 6MM Laminated glass infil to suppliers specification and Architect's Approval with pv

WINDOW SCHEDULE

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

JOB NO

DRG.NO

B107



Window ID	W - 05
Size	3000 x 8400
Quantity	2
Description	Powder coated aluminium Louvres to suppliers specification and Architect's Approval



Window ID	W - 06
Size	4800 x 8400
Quantity	2
Description	Powder coated aluminium Louvres to suppliers specification and Architect's Approval

WINDOW SCHEDULE

NOTES

GENERAL NOTES

1

This drawing is protected under the copyright Act , and cannot be used or reproduced in part or in whole without authors consent .

2

Read only figured dimensions .

3

All construction work is to comply with the latest K.B.S. standard codes of practice , Local Authority By-Laws, and Fire regulations .

4

P.V. denotes permanent ventilation and must be provided above all doors and windows where indicated or shown

5

All walls less than 200mm thick to be reinforced with hoop iron at every alternate course

6

Water Meter to be 300mm above G.L.

7

D.p.c. denotes one layer of bituminous felt to be provided under all walls 150mm above G.L.

8

All R.C. works to structural engineer's details.

9

Provide 1 row of 600x600x50mm precast conc paving slabs around the building unless otherwise shown .

10

Contractors must verify all dimensions and levels on site before commencing work . Any discrepancies must be reported to the architect before work is put in hand .

11

All levels shown are finished levels unless otherwise stated.

12

All surface beds to be cast on well compacted and well consolidated filling .

13

Depth of foundation trenches to be minimum 600mm below reduced ground level .

14

All pipes and services to be minimum 450mm below reduced ground level .

REVISIONS

No.	Date	Revision/Issue

ARCHITECT

CLIENT

KENYA URBAN ROADS AUTHORITY

P.O. BOX 41727 - 00100

DIRECTOR (RACM)

SIGN

DATE

PROJECT

Proposed Offices in Lower Eastern Region, Machakos County

SITE: L.R. No. _ _ _ _ _

DRAWING TITLE

JOB NO

DRG.NO

B108

THANK YOU!